


|        |                   |    |  |      |
|--------|-------------------|----|--|------|
| 形名     | MY-N430240/N AHTN | 電源 |  | ○諸特性 |
| 出力     | 段調光               | 温度 |  |      |
| モード    | 節電                |    |  |      |
| オプション1 |                   |    |  |      |
| オプション2 |                   |    |  |      |
| オプション3 |                   |    |  |      |
| オプション4 |                   |    |  |      |
| オプション5 |                   |    |  |      |




|                |      |       |       |        |       |    |       |
|----------------|------|-------|-------|--------|-------|----|-------|
| 光源             |      | LED   |       |        |       |    |       |
| 最大<br>取付<br>間隔 | 高さ   | H     |       |        |       |    |       |
|                | A-A' | 1.2 H |       |        |       |    |       |
|                | B-B' | 1.2 H |       |        |       |    |       |
| 器具効率           |      | 上方光束  | 下方光束  | 計      |       |    |       |
|                |      | 9.0%  | 91.0% | 100.0% |       |    |       |
| 保守率            |      | 良い    | 0.810 | 普通     | 0.770 | 悪い | 0.680 |

○配光曲線図 (cd/1000lm)

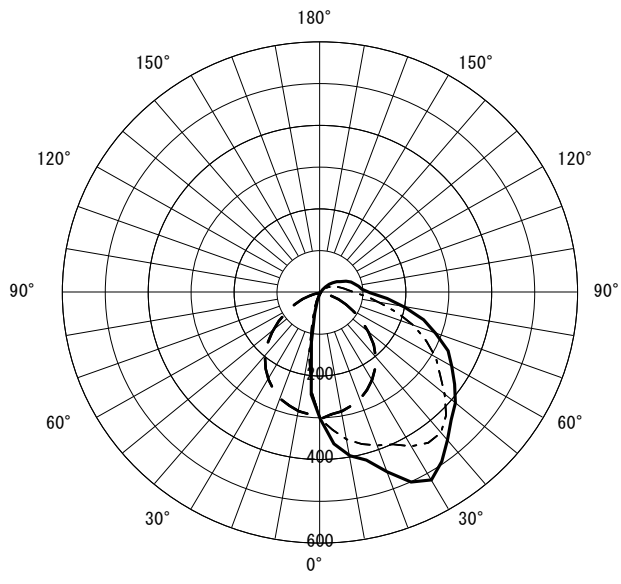

○直射水平面照度 (全光束: 2140 × 1 = 2140lm/台)  
照度 (lx) — H1.50m --- H2.00m - - - H2.50m - · - · H3.00m (保守率: 1.00)

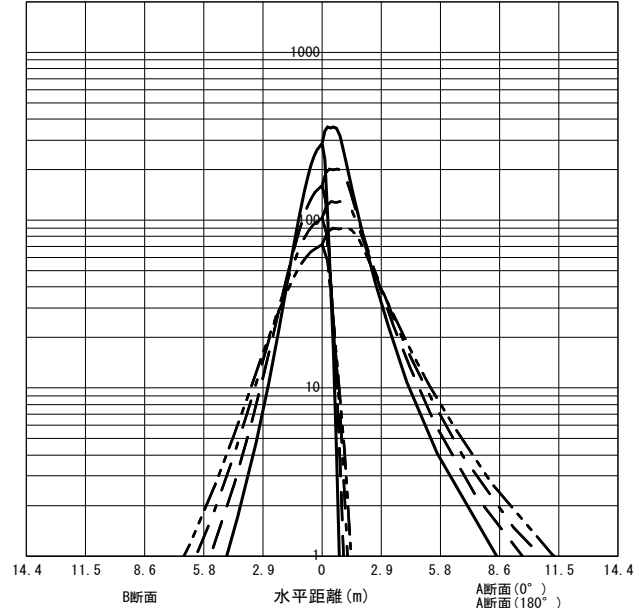

| 反射率 (%) |                 |     |     |    |     |    |     |    |     |    |     |    |     |    |     |    |     |    |     |    |     |    |    |    |    |    |    |    |    |    |    |    |    |    |
|---------|-----------------|-----|-----|----|-----|----|-----|----|-----|----|-----|----|-----|----|-----|----|-----|----|-----|----|-----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| 天井      | 80              |     |     |    |     |    |     |    | 70  |    |     |    | 50  |    |     |    | 30  |    |     |    | 20  | 0  |    |    |    |    |    |    |    |    |    |    |    |    |
| 壁       | 70              | 50  | 30  | 10 | 70  | 50 | 30  | 10 | 70  | 50 | 30  | 10 | 70  | 50 | 30  | 10 | 70  | 50 | 30  | 10 | 10  | 0  |    |    |    |    |    |    |    |    |    |    |    |    |
| 床       | 30              | 10  | 30  | 10 | 30  | 10 | 30  | 10 | 30  | 10 | 30  | 10 | 30  | 10 | 30  | 10 | 30  | 10 | 30  | 10 | 30  | 10 | 30 | 10 | 30 | 10 | 30 | 10 | 30 | 10 | 30 | 10 | 0  |    |
| 室指数     | 作業面照明率 (× 0.01) |     |     |    |     |    |     |    |     |    |     |    |     |    |     |    |     |    |     |    |     |    |    |    |    |    |    |    |    |    |    |    |    |    |
| 0.60    | 58              | 53  | 43  | 41 | 34  | 33 | 27  | 27 | 56  | 52 | 42  | 40 | 33  | 32 | 27  | 27 | 51  | 48 | 39  | 38 | 32  | 31 | 26 | 26 | 48 | 45 | 37 | 36 | 31 | 30 | 26 | 25 | 25 | 23 |
| 0.80    | 69              | 63  | 54  | 51 | 45  | 43 | 38  | 37 | 67  | 61 | 53  | 50 | 44  | 42 | 37  | 36 | 61  | 57 | 50  | 48 | 42  | 41 | 36 | 35 | 57 | 54 | 47 | 45 | 40 | 39 | 35 | 35 | 34 | 32 |
| 1.00    | 78              | 70  | 63  | 58 | 53  | 50 | 45  | 44 | 74  | 67 | 61  | 57 | 52  | 49 | 45  | 43 | 68  | 63 | 57  | 54 | 49  | 47 | 43 | 42 | 63 | 59 | 54 | 52 | 47 | 46 | 42 | 41 | 41 | 38 |
| 1.25    | 85              | 76  | 71  | 65 | 61  | 57 | 54  | 51 | 81  | 73 | 69  | 64 | 60  | 56 | 53  | 51 | 75  | 69 | 64  | 61 | 57  | 54 | 51 | 49 | 69 | 65 | 60 | 58 | 54 | 52 | 49 | 48 | 47 | 44 |
| 1.50    | 91              | 80  | 77  | 70 | 68  | 63 | 60  | 57 | 87  | 77 | 75  | 69 | 66  | 62 | 59  | 56 | 79  | 73 | 70  | 65 | 62  | 59 | 56 | 54 | 73 | 69 | 65 | 62 | 59 | 57 | 54 | 53 | 52 | 49 |
| 2.00    | 98              | 86  | 87  | 77 | 78  | 71 | 70  | 65 | 94  | 83 | 83  | 76 | 75  | 69 | 69  | 64 | 86  | 78 | 78  | 72 | 71  | 67 | 65 | 62 | 79 | 74 | 72 | 69 | 67 | 64 | 62 | 60 | 59 | 56 |
| 2.50    | 103             | 89  | 93  | 82 | 85  | 76 | 78  | 71 | 99  | 87 | 89  | 80 | 82  | 75 | 76  | 70 | 90  | 82 | 83  | 77 | 77  | 72 | 72 | 68 | 83 | 78 | 77 | 73 | 72 | 69 | 68 | 66 | 65 | 61 |
| 3.00    | 107             | 92  | 98  | 86 | 90  | 80 | 83  | 75 | 102 | 89 | 94  | 84 | 87  | 79 | 81  | 74 | 93  | 85 | 87  | 80 | 81  | 76 | 76 | 72 | 85 | 80 | 80 | 76 | 76 | 73 | 72 | 69 | 68 | 65 |
| 4.00    | 112             | 95  | 104 | 90 | 98  | 86 | 92  | 82 | 107 | 93 | 100 | 88 | 94  | 84 | 89  | 80 | 97  | 88 | 92  | 84 | 87  | 81 | 83 | 77 | 89 | 84 | 85 | 80 | 81 | 78 | 78 | 75 | 74 | 70 |
| 5.00    | 115             | 97  | 108 | 93 | 103 | 89 | 97  | 86 | 110 | 95 | 104 | 91 | 99  | 87 | 94  | 84 | 100 | 90 | 95  | 87 | 91  | 84 | 88 | 81 | 91 | 86 | 88 | 83 | 85 | 81 | 82 | 78 | 77 | 73 |
| 7.00    | 119             | 100 | 113 | 96 | 109 | 93 | 105 | 91 | 113 | 97 | 109 | 94 | 104 | 92 | 101 | 89 | 103 | 93 | 100 | 90 | 96  | 88 | 93 | 86 | 94 | 89 | 92 | 86 | 89 | 85 | 87 | 83 | 81 | 78 |
| 10.00   | 122             | 102 | 118 | 99 | 114 | 97 | 111 | 95 | 116 | 99 | 112 | 97 | 109 | 95 | 106 | 93 | 106 | 95 | 103 | 93 | 100 | 91 | 98 | 90 | 97 | 91 | 95 | 89 | 93 | 88 | 91 | 86 | 85 | 81 |

JIS C 8030:2014

三菱電機照明株式会社