
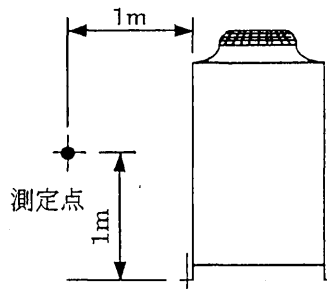


冷電技術ノート	作成		改定			
	検認	01-4-23				

騒音分析成績表

PUH-P224FA(-BS, -BSG)

測定場所: 無響音室  
計器: B&K



		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性	
冷房	50Hz	65	58	56	56	48	45	41	35	56	(dB)
冷房	60Hz	65	58	56	56	48	45	41	35	56	
暖房	50Hz	67	58	56	55	49	46	43	39	56	
暖房	60Hz	69	59	56	56	51	47	43	40	57	

