



騒音分析成績表

PUHV-P560M-E (-BS, -BSG)

測定場所: 無響音室  
計器: B&K

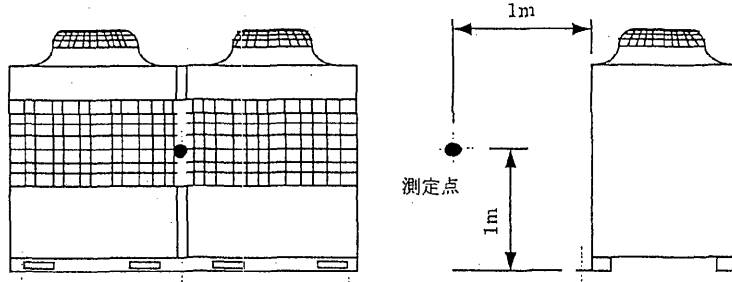

		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性	
標準	50Hz	67	61.5	60.5	58	53.5	50.5	48	43	60	(dB)
	60Hz	68	65	60.5	59	54	51.5	49	43.5	61	(dB)
ナイトモード	50/60Hz	60	52.5	52.0	52.5	45.5	43.0	39	38.5	53	(dB)

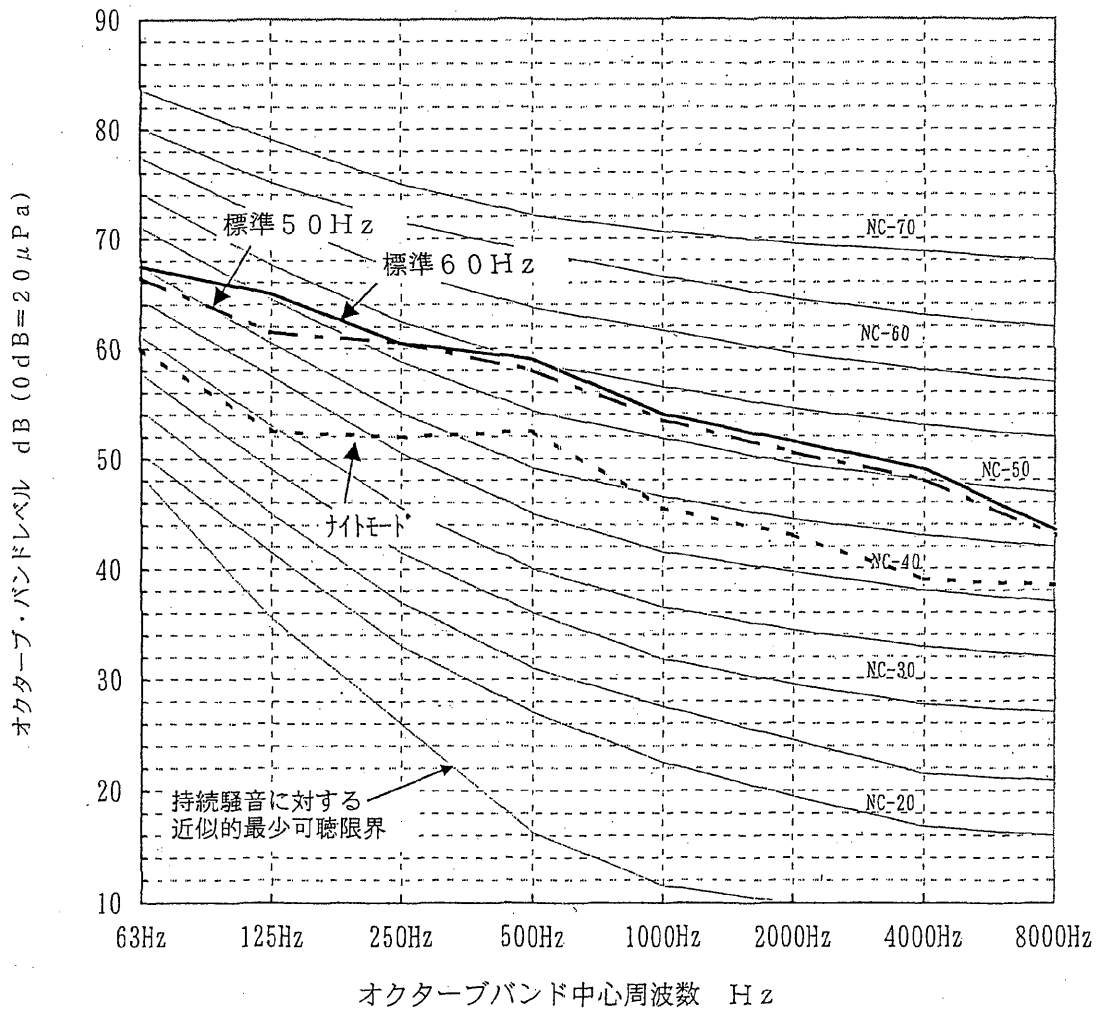

WYNB0-3267