
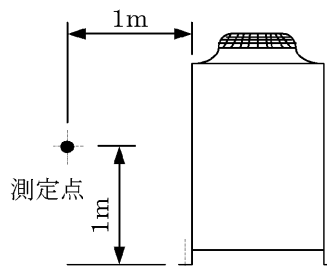


冷電技術ノート	作成 検認		改定	A			
---------	----------	--	----	---	--	--	--

騒音分析成績表

PUHY-P355MKH-E(-BS,-BSG)

測定場所:無響音室
計器:B&K



		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性	
冷房/暖房(標準)	50/60Hz	62.5	58.5	55.5	53.5	50.5	49	48	44	57	(dB)
蓄冷	50/60Hz	56.5	53.5	52	47.5	44	39.5	36.5	36	50	(dB)
急蓄冷	50/60Hz	62.5	58.5	55.5	53.5	50.5	49	48	44	57	(dB)
蓄熱	50/60Hz	61.5	57.5	55	52	49	46	45	42.5	55	(dB)
ナイトモード	50/60Hz	56.5	53.5	52	47.5	44	39.5	36.5	36	50	(dB)

