


### 騒音分析成績表

PUZ-P140IGA-H(-BS,-BSG)

60Hz

測定場所: 無響音室


計器: B&K

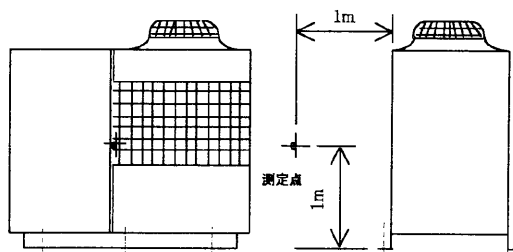

		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性	
60Hz	蓄冷/蓄熱	61.6	44.4	45.0	41.4	37.9	36.4	31.3	33.3	45	(dB)
	冷房/暖房	62.6	46.7	45.3	45.4	41.2	41.3	33.7	33.6	48	(dB)

蓄冷/蓄熱 (60Hz)

冷房/暖房 (60Hz)

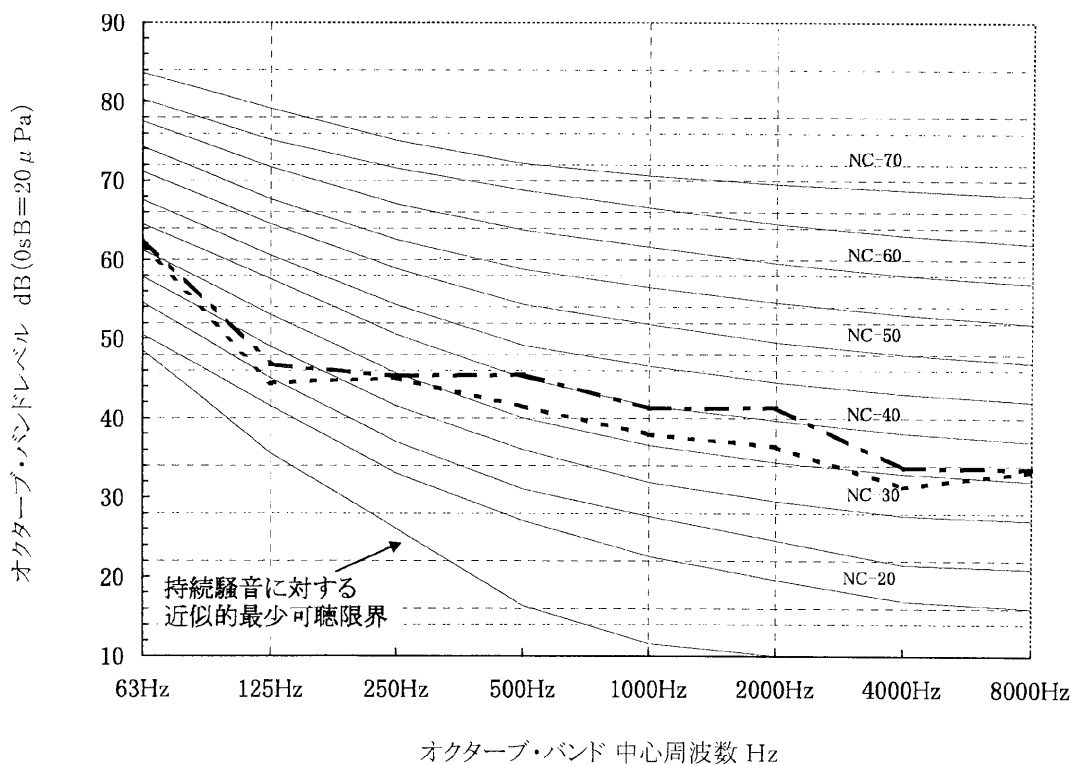

WYNB0-4039