


騒音分析成績表

PUZ-P140IGA-H(-BS,-BSG)

50Hz

測定場所:無響音室
計器:B&K

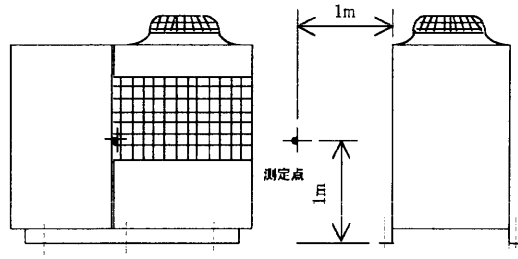

		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性	
50Hz	蓄冷/蓄熱	61.6	44.0	47.7	42.0	37.4	36.2	30.9	32.8	45	(dB)
	冷房/暖房	62.1	46.4	49.7	42.5	42.2	41.0	33.4	33.1	48	(dB)

--- 蓄冷/蓄熱 (50Hz) -.-.- 冷房/暖房 (50Hz)

