


騒音分析成績表

PUZ-P160IGA(-BS,-BSG)

50Hz

測定場所:無響音室

計器:B&K

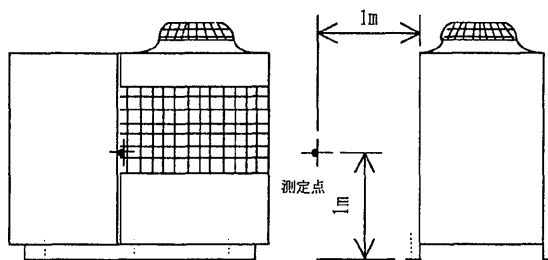

		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
50Hz	蓄冷	61.6	44.0	47.7	42.0	37.4	36.2	30.9	32.8	45 (dB)
	冷房/暖房	60.6	49.5	52.4	47.5	43.2	41.9	36.4	31.6	50 (dB)

蓄冷 (50Hz)

冷房/暖房 (50Hz)

