



騒音分析成績表

PFAV-P450(V)DMJ1

測定場所: 無響音室
計器: B & K

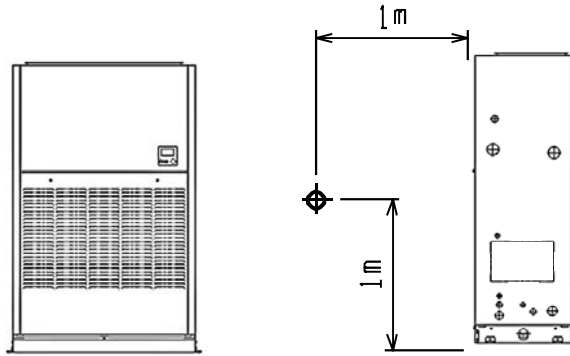


63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
62.0	59.0	58.5	55.5	52.5	48.5	45.5	37.0	58 (dB)

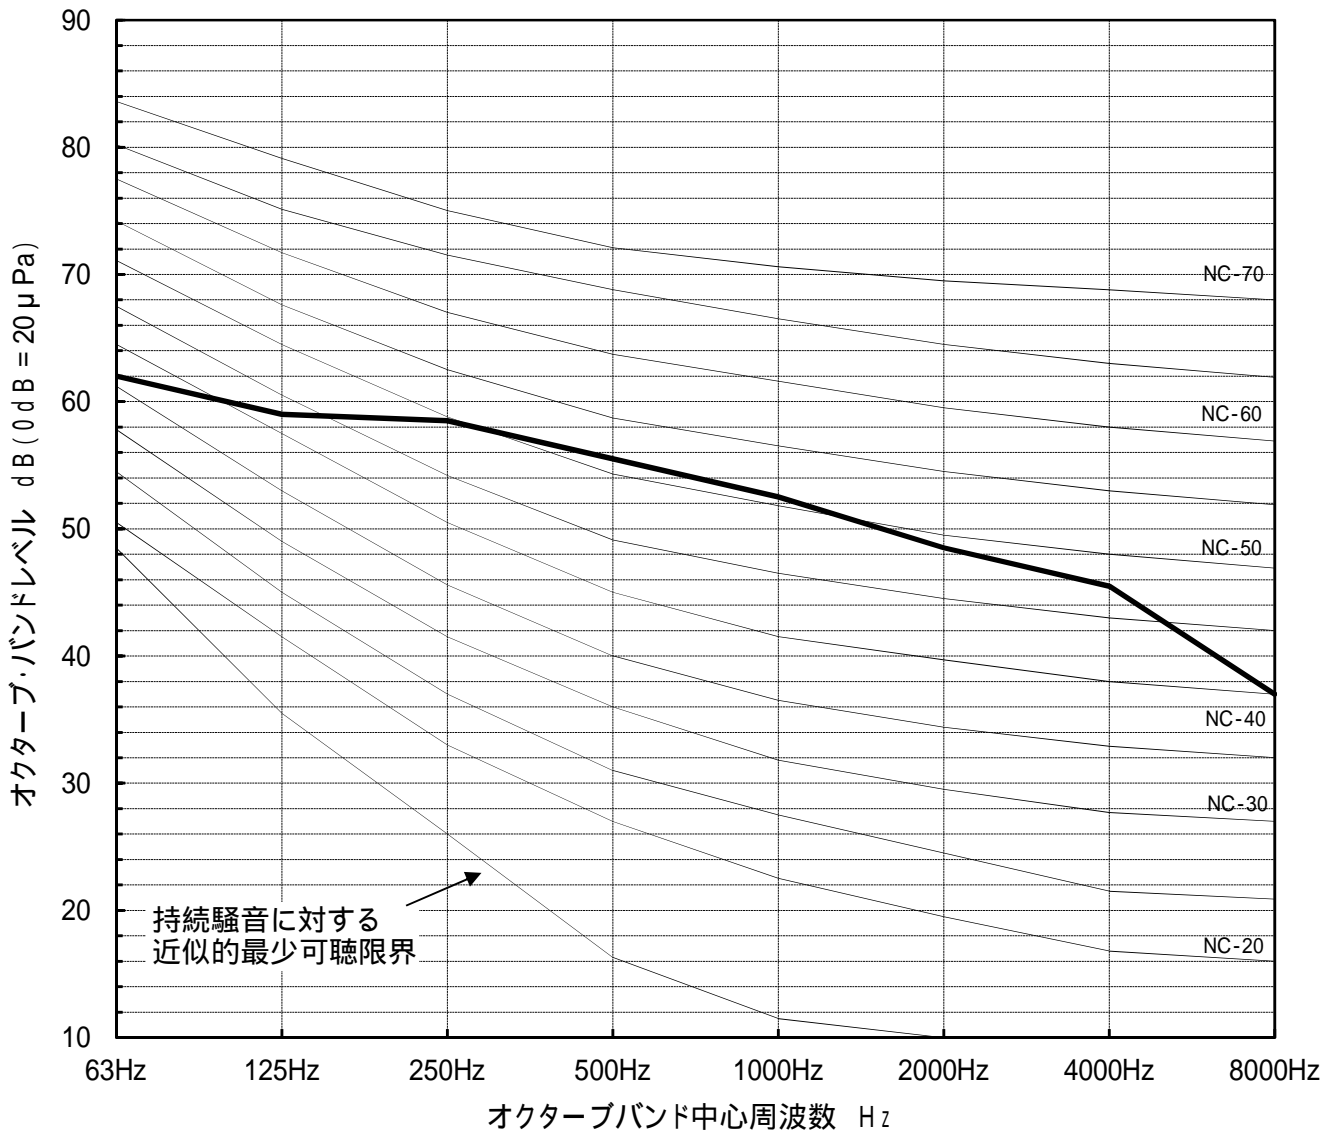

騒音分析成績表

PFAV-P450(V)DMJ1 (別売プレナム取付時)
別売形名:PAC-CD05PL

測定場所:無響音室
計 器: B & K

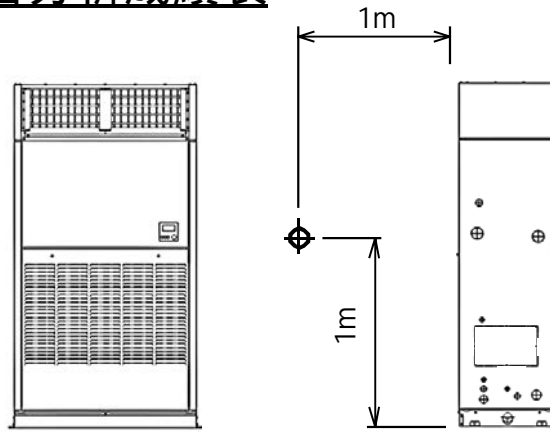

63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
67.0	63.0	64.0	62.0	59.5	57.5	53.5	45.0	65 (dB)

