



騒音分析成績表

PFAV-P560(V)DMJ1

測定場所: 無響音室
計器: B & K

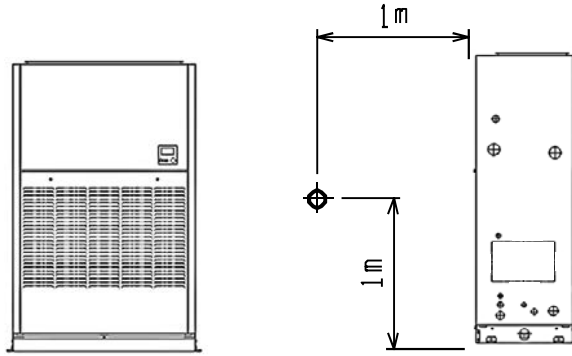


63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
64.5	62.0	60.5	58.0	56.5	52.0	48.5	41.0	61 (dB)

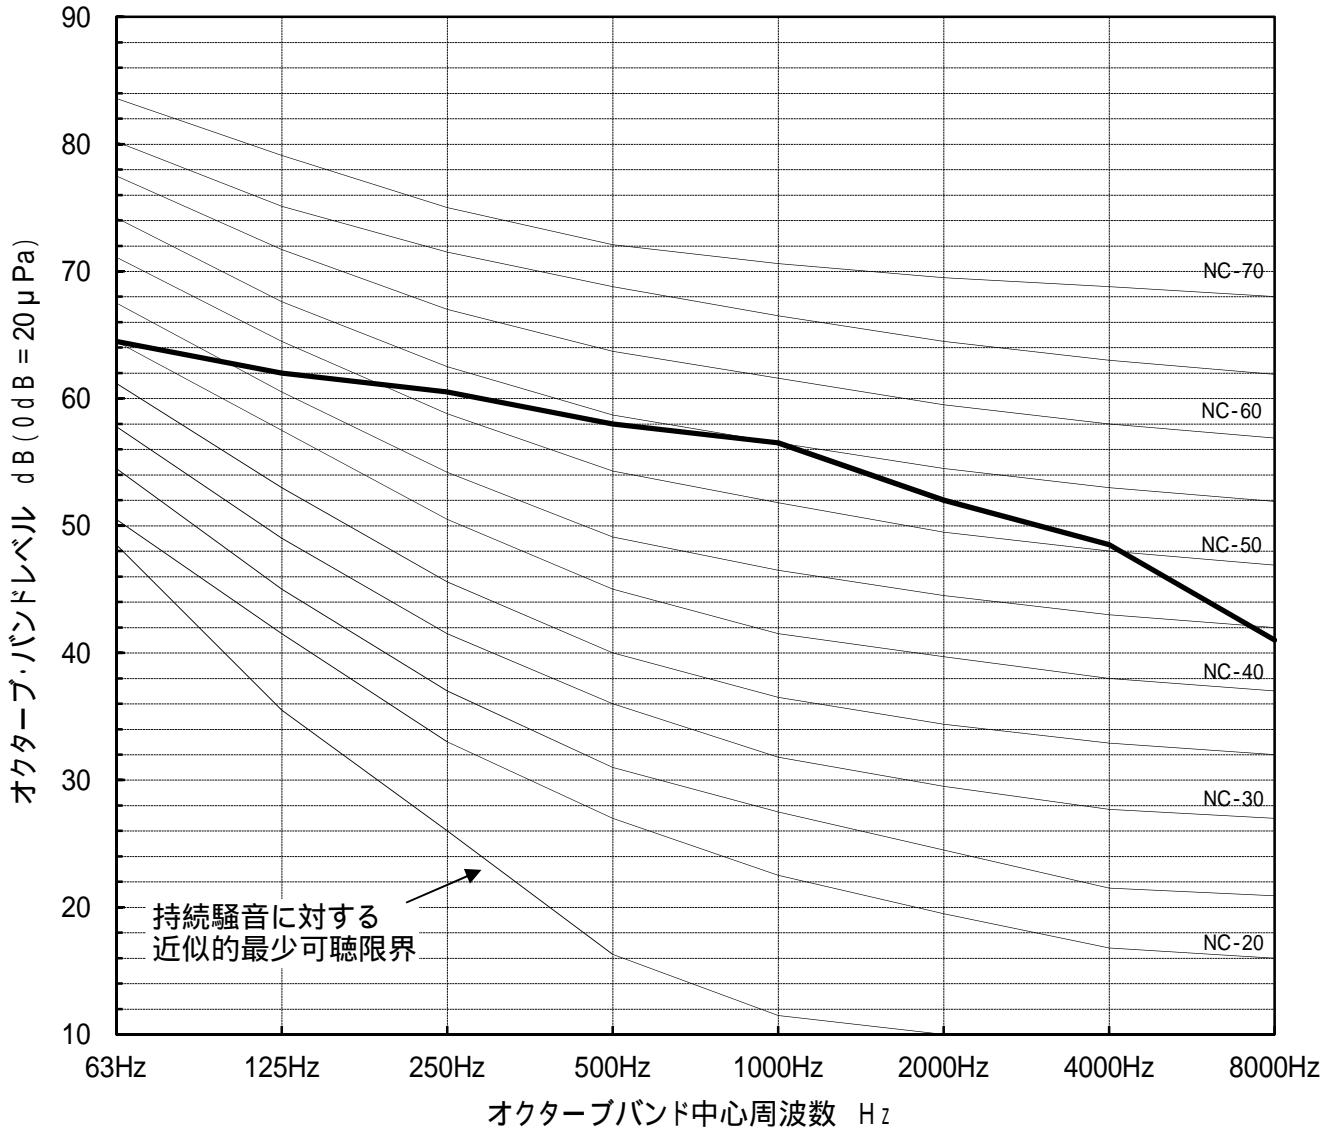

騒音分析成績表

PFAV-P560(V)DMJ1 (別売プレナム取付時)
別売形名:PAC-CD05PL

測定場所:無響音室
計器:B & K

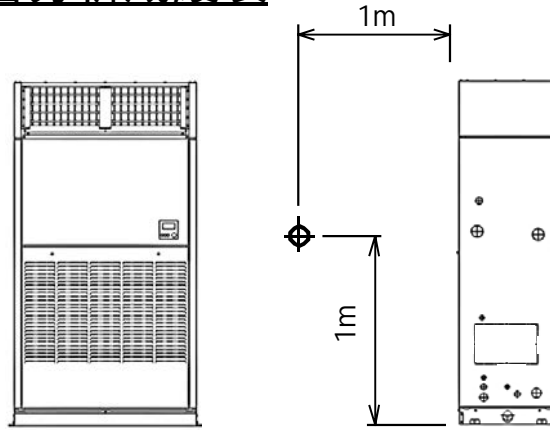

63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
70.5	67.0	67.5	66.0	63.5	62.0	57.5	49.5	69 (dB)

