


騒音分析成績表

PFAV-P1400(V)DMJ1

測定場所: 無響音室
計器: B & K

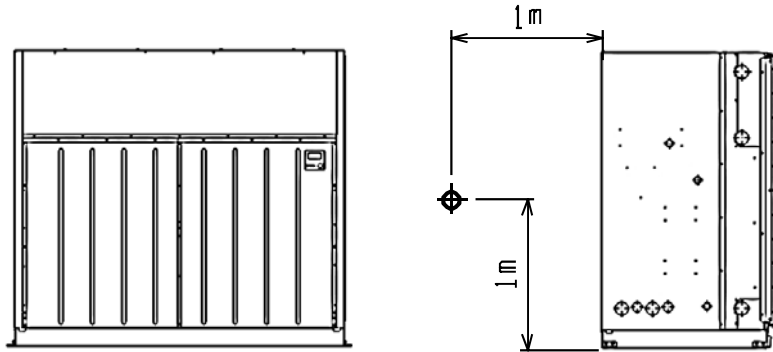

| 63Hz | 125Hz | 250Hz | 500Hz | 1000Hz | 2000Hz | 4000Hz | 8000Hz | A特性 |
|------|-------|-------|-------|--------|--------|--------|--------|---------|
| 69.5 | 68.5 | 61.0 | 58.5 | 52.5 | 47.0 | 44.5 | 38.0 | 60 (dB) |

