


騒音分析成績表

PFAV-P1600(V)DMJ1

測定場所: 無響音室
計器: B & K

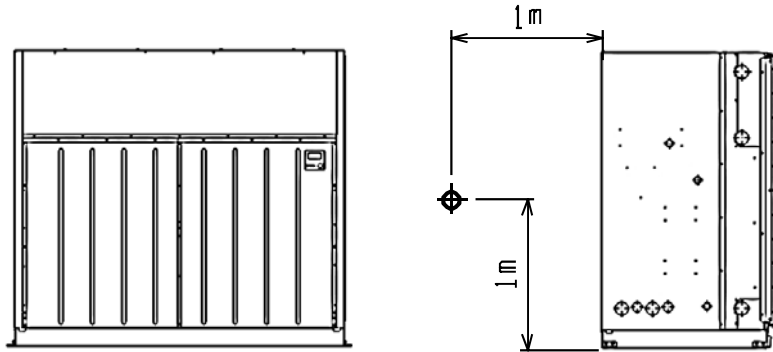

| 63Hz | 125Hz | 250Hz | 500Hz | 1000Hz | 2000Hz | 4000Hz | 8000Hz | A特性 |
|------|-------|-------|-------|--------|--------|--------|--------|-----------|
| 70.5 | 70.5 | 64.5 | 60.5 | 55.0 | 50.0 | 47.0 | 41.5 | 62.5 (dB) |

