



騒音分析成績表

PFAV-P280(V)DMJ1

測定場所: 無響音室
計器: B & K

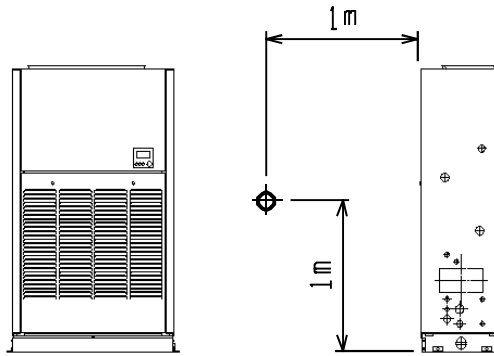


63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
65.0	64.0	60.5	57.5	54.5	47.5	42.5	34.5	59.5 (dB)

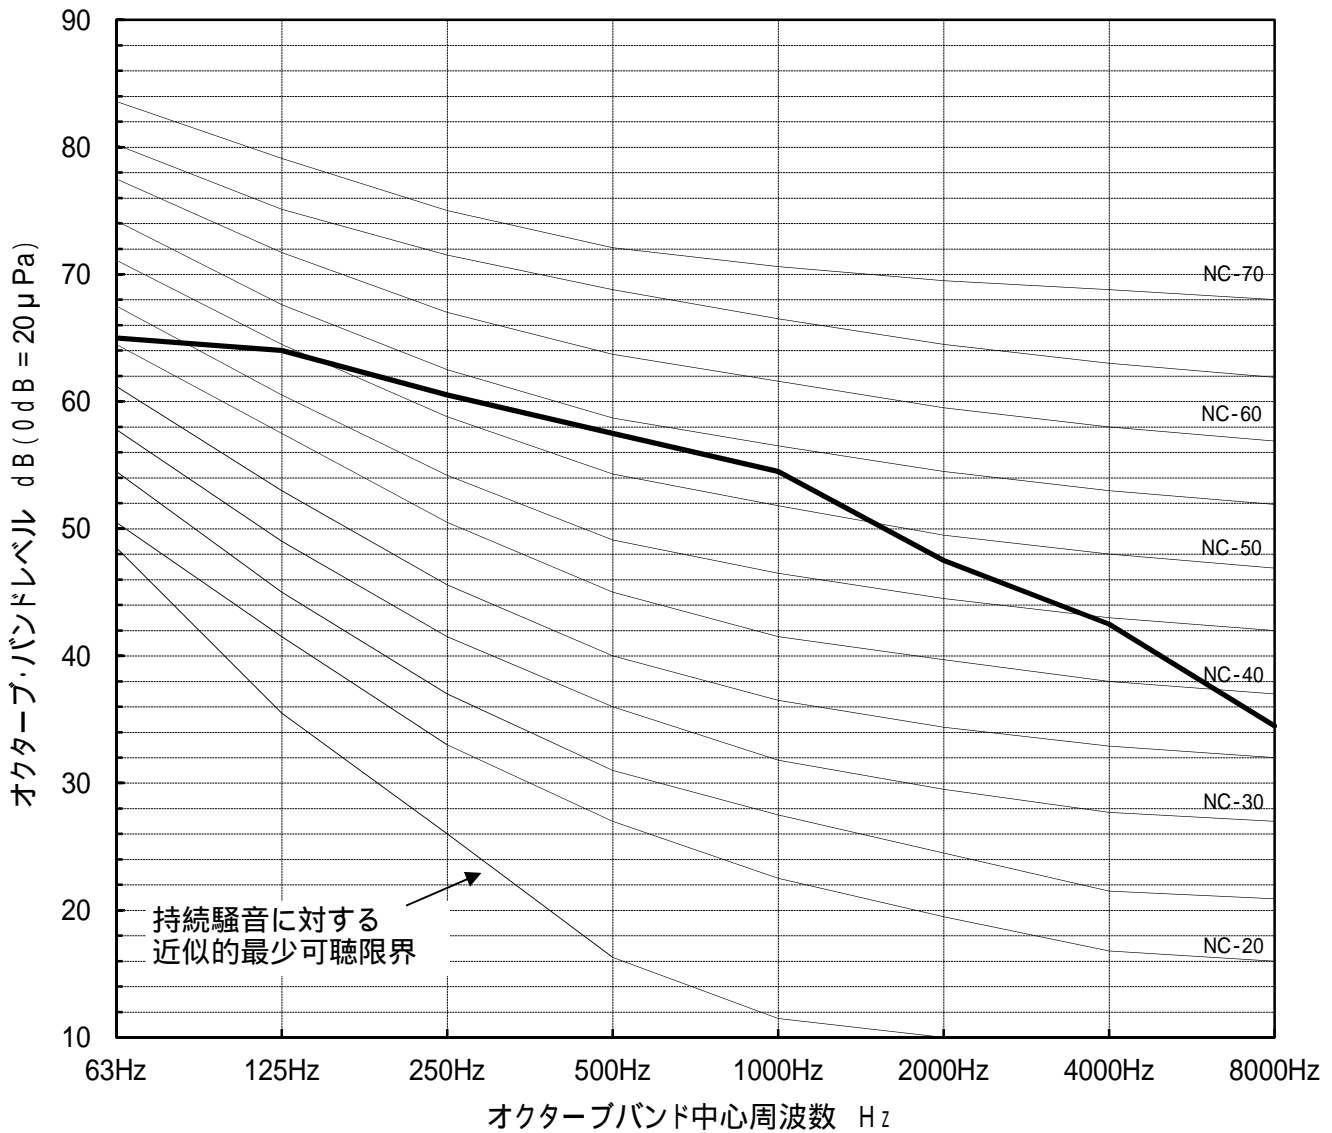

騒音分析成績表

PFAV-P280(V)DMJ 1 (別売プレナム取付時)

測定場所: 無響音室
計器: B & K

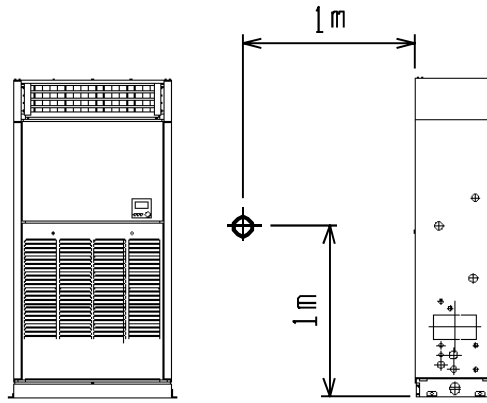

63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
68.0	67.0	67.5	64.5	65.0	60.0	57.5	52.0	69 (dB)

