



騒音分析成績表

PFAV-P80(V)DMJ1

測定場所: 無響音室
計器: B & K

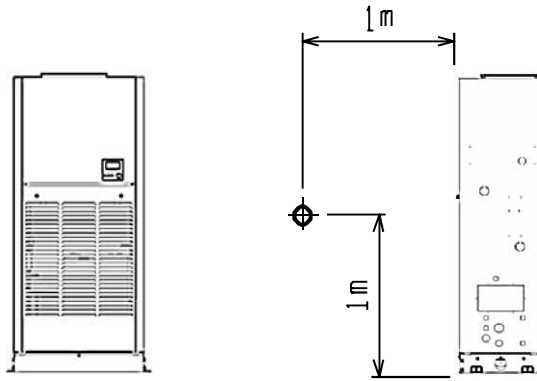

63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
59.5	55.0	47.5	43.0	34.0	29.0	23.5	13.5	45 (dB)

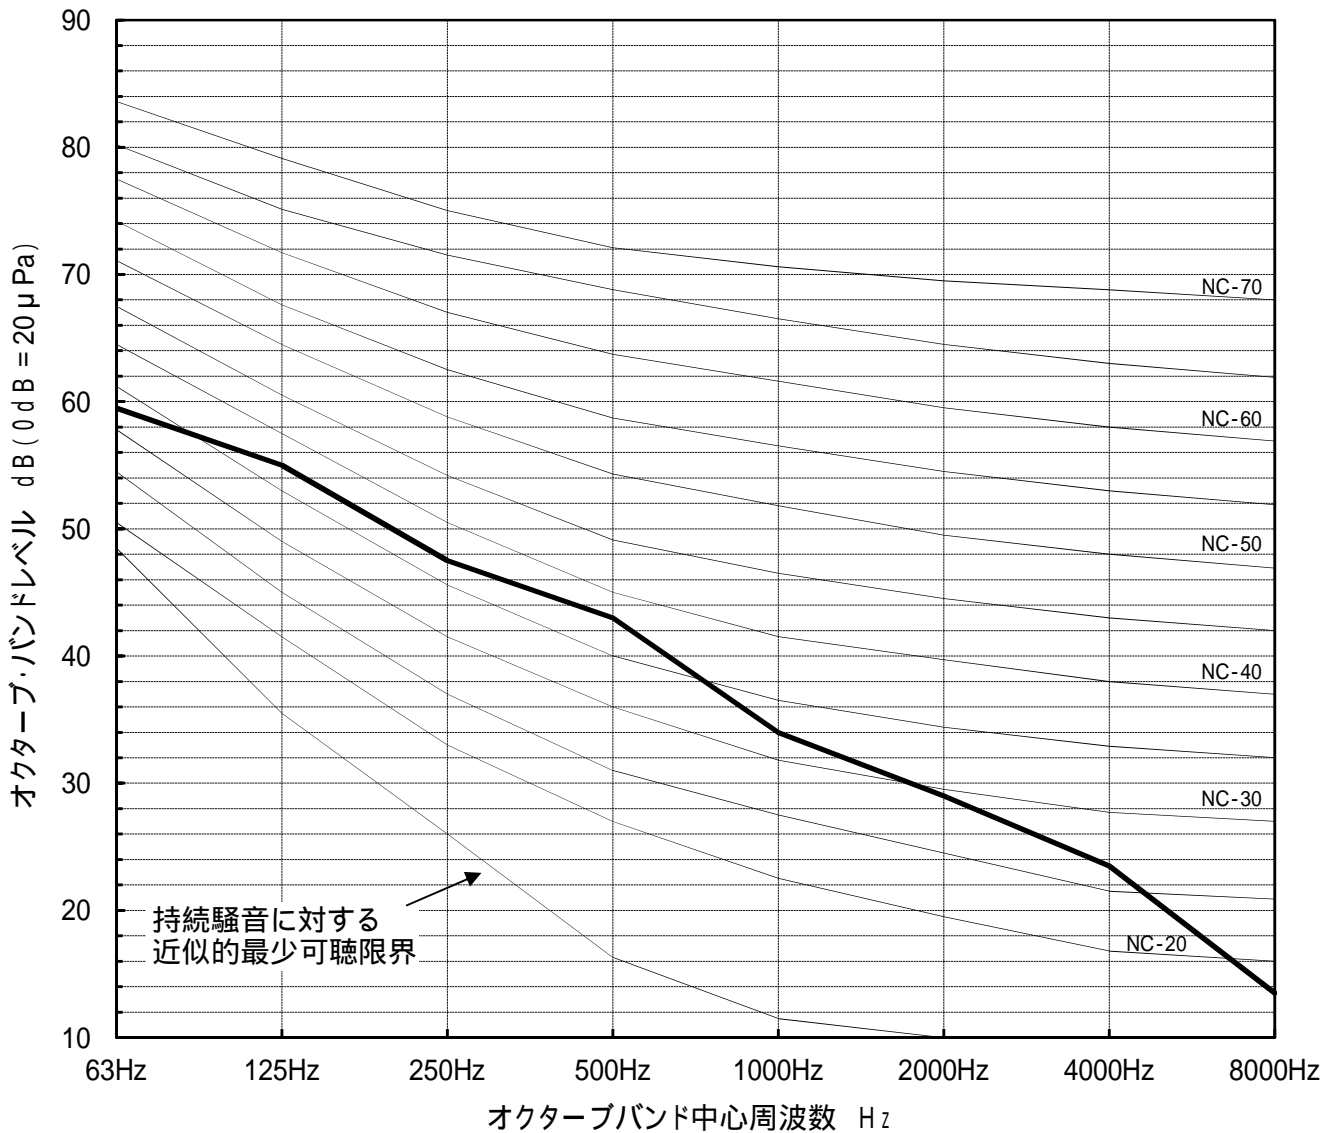



騒音分析成績表

PFAV-P80(V)DMJ1 (別売プレミアム取付時)

別売形名:PAC-CD01PL

測定場所:無響音室

計器:B & K

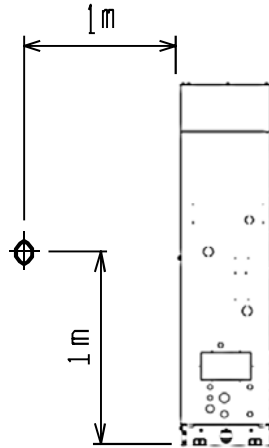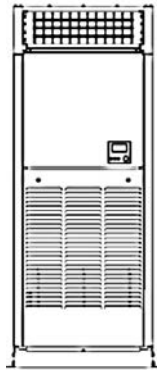

63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
56.5	56.5	52.5	48.0	47.5	43.0	38.0	31.5	52 (dB)

