



# 騒音分析成績表

PFAV-P140(V)DMJ1

測定場所: 無響音室  
計器: B & K

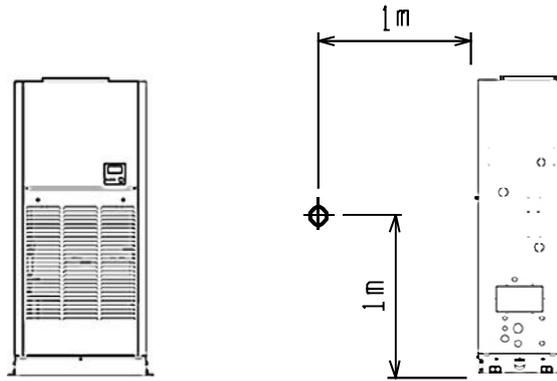

63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
64.0	62.5	55.0	49.0	41.0	37.5	32.0	21.0	52 (dB)

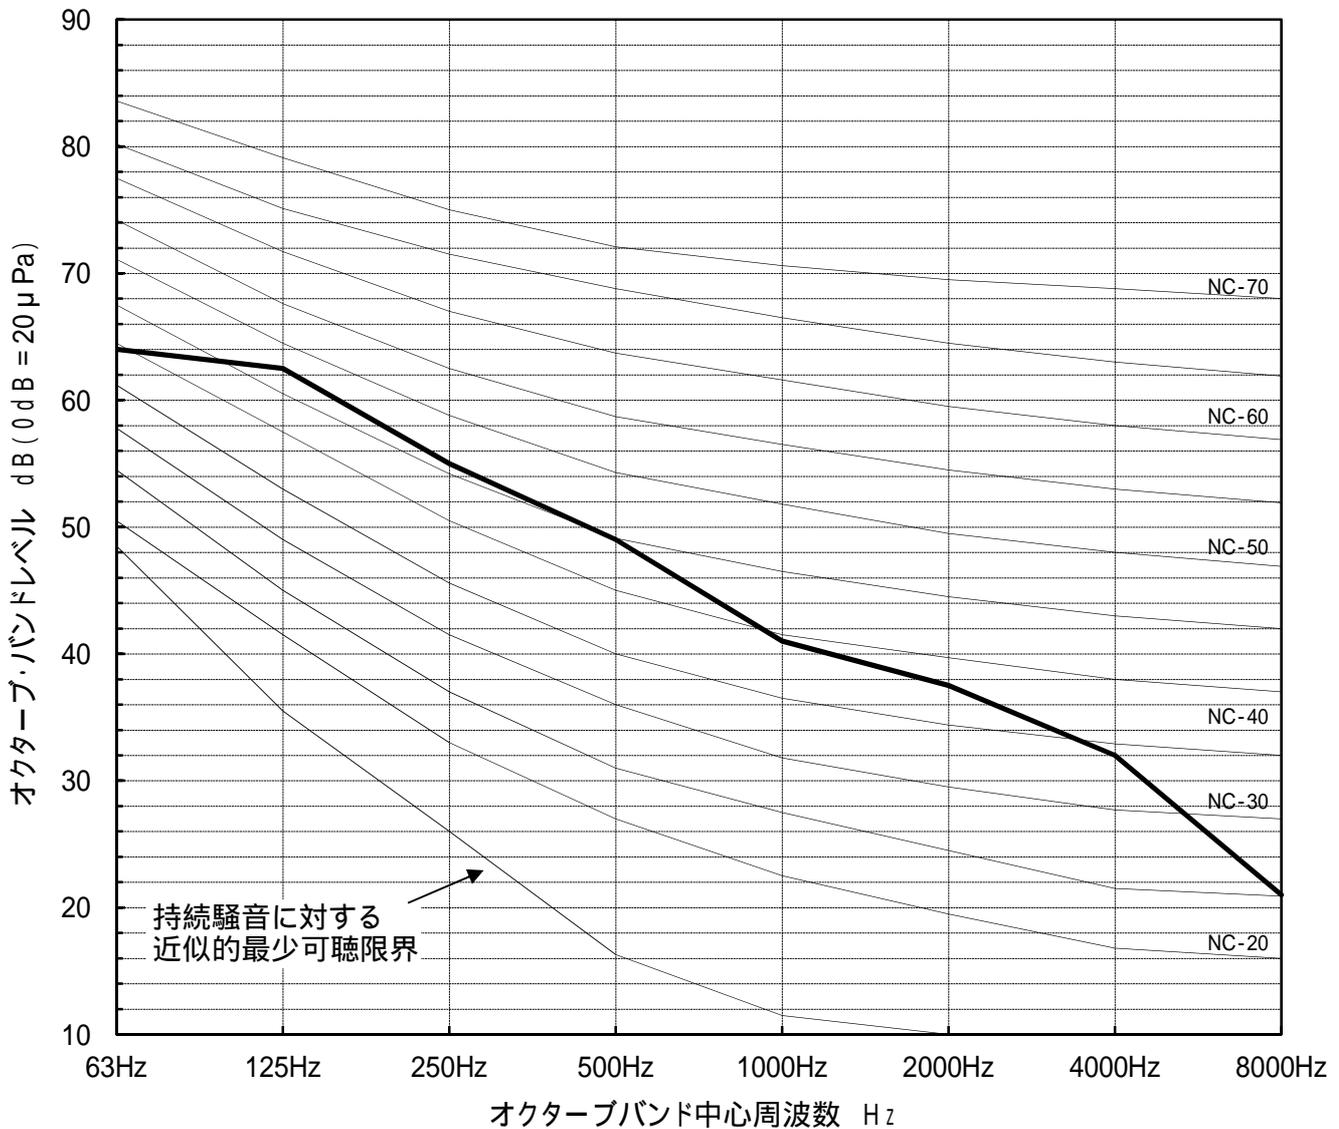


# 騒音分析成績表

PFAV-P140(V)DMJ1 (別売プレナム取付時)

別売形名:PAC-CD01PL

測定場所:無響音室

計器:B & K

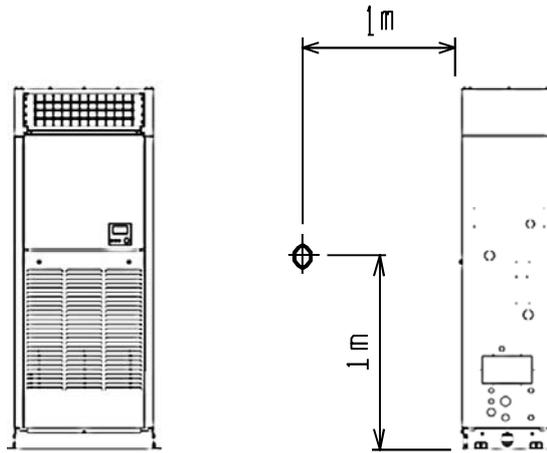

63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
65.0	66.0	61.5	58.0	57.5	53.0	49.5	43.5	62 (dB)

