



騒音分析成績表

PUHV-RP280(V)DMJ(-BS,-BSG)

測定場所: 無響音室
計器: B&K

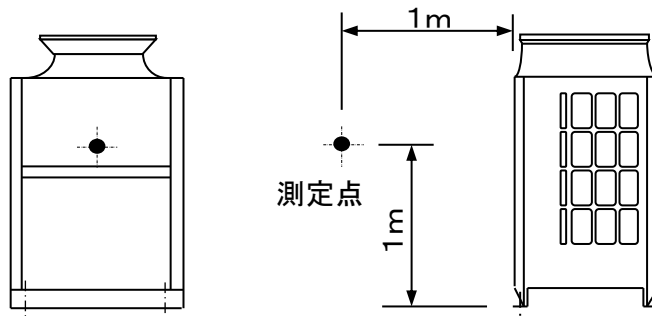


| | 63Hz | 125Hz | 250Hz | 500Hz | 1000Hz | 2000Hz | 4000Hz | 8000Hz | A特性 | |
|-----|------|-------|-------|-------|--------|--------|--------|--------|-----|------|
| 標準 | 68.5 | 65.0 | 58.5 | 56.5 | 51.0 | 47.0 | 42.0 | 37.5 | 58 | (dB) |
| 低騒音 | 56.5 | 56.0 | 48.0 | 43.0 | 42.0 | 33.0 | 27.0 | 30.5 | 47 | (dB) |

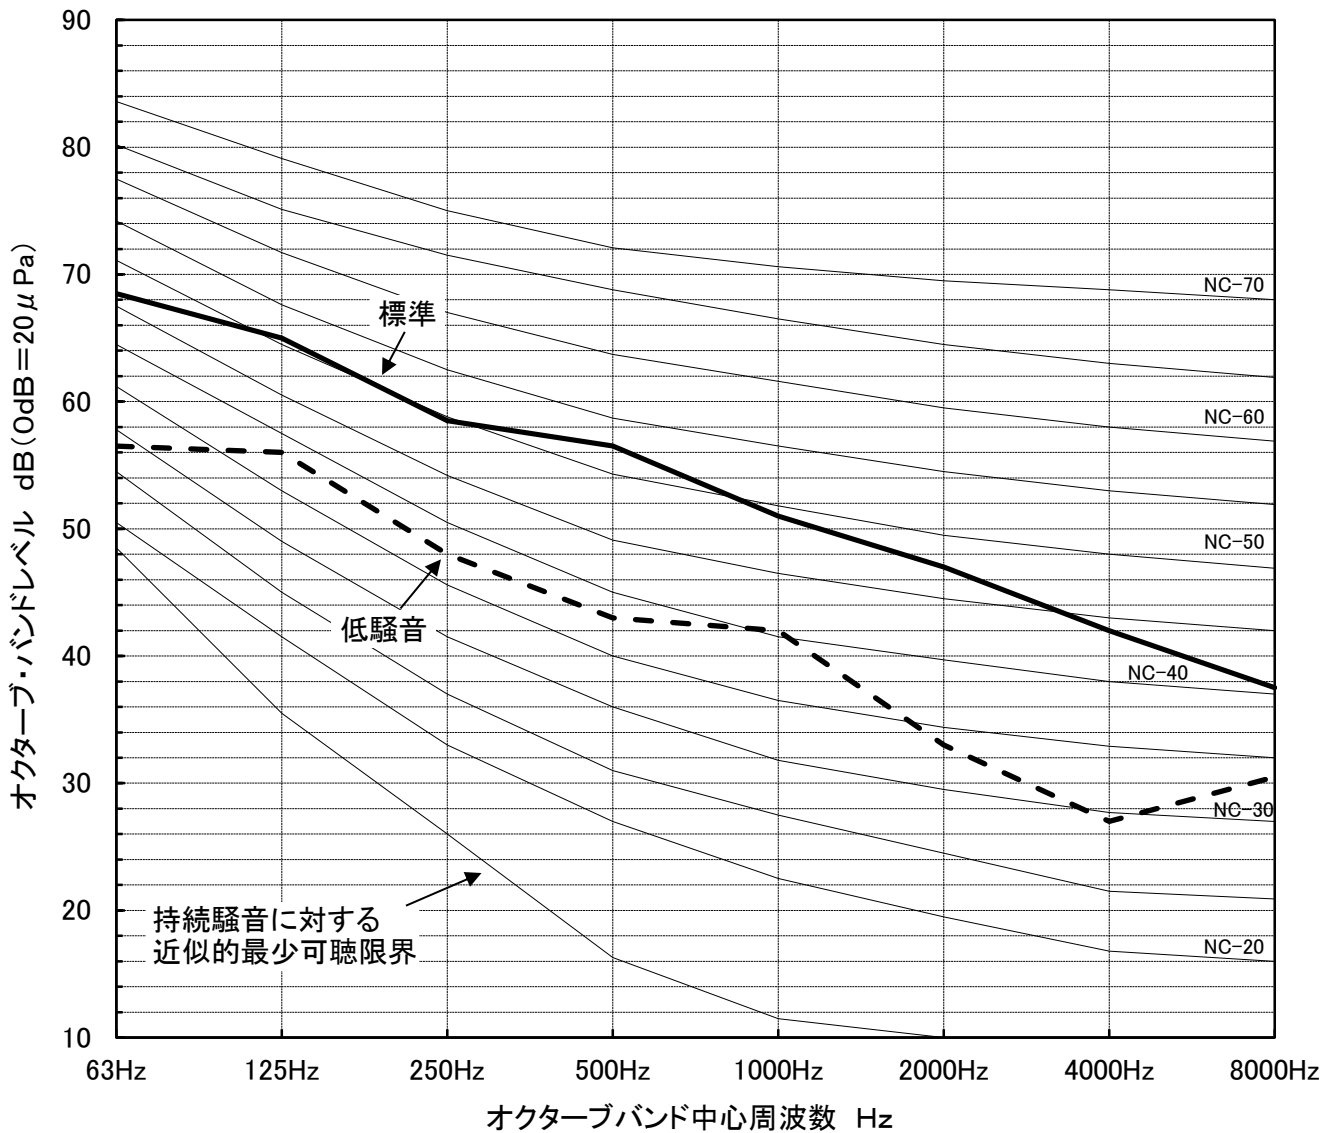

騒音分析成績表

PUHV-RP280(V)DMJ(-BS,-BSG) × 2

測定場所: 無響音室
計器: B&K

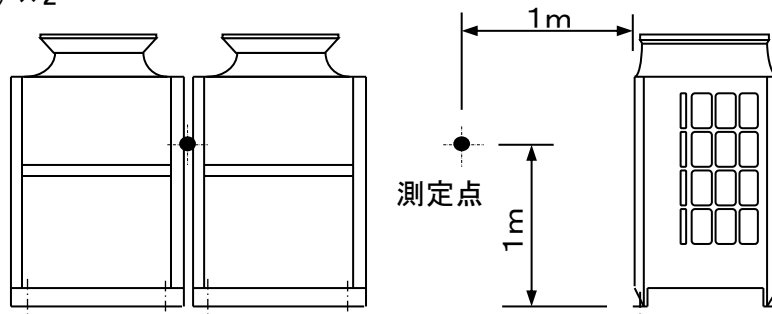

| | 63Hz | 125Hz | 250Hz | 500Hz | 1000Hz | 2000Hz | 4000Hz | 8000Hz | A特性 | |
|-----|------|-------|-------|-------|--------|--------|--------|--------|-----|------|
| 標準 | 71.5 | 68.0 | 61.5 | 59.5 | 54.0 | 50.0 | 45.0 | 40.5 | 61 | (dB) |
| 低騒音 | 59.5 | 59.0 | 51.0 | 46.0 | 45.0 | 36.0 | 30.0 | 33.5 | 50 | (dB) |

