



騒音分析成績表

PFAV-XP280(V)DMJ

測定場所: 無響音室
計器: B&K

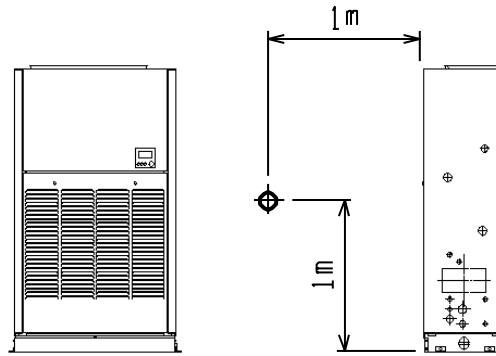


| 63Hz | 125Hz | 250Hz | 500Hz | 1000Hz | 2000Hz | 4000Hz | 8000Hz | A特性 |
|------|-------|-------|-------|--------|--------|--------|--------|-----------|
| 65.0 | 64.0 | 60.5 | 57.5 | 54.5 | 47.5 | 42.5 | 34.5 | 59.5 (dB) |

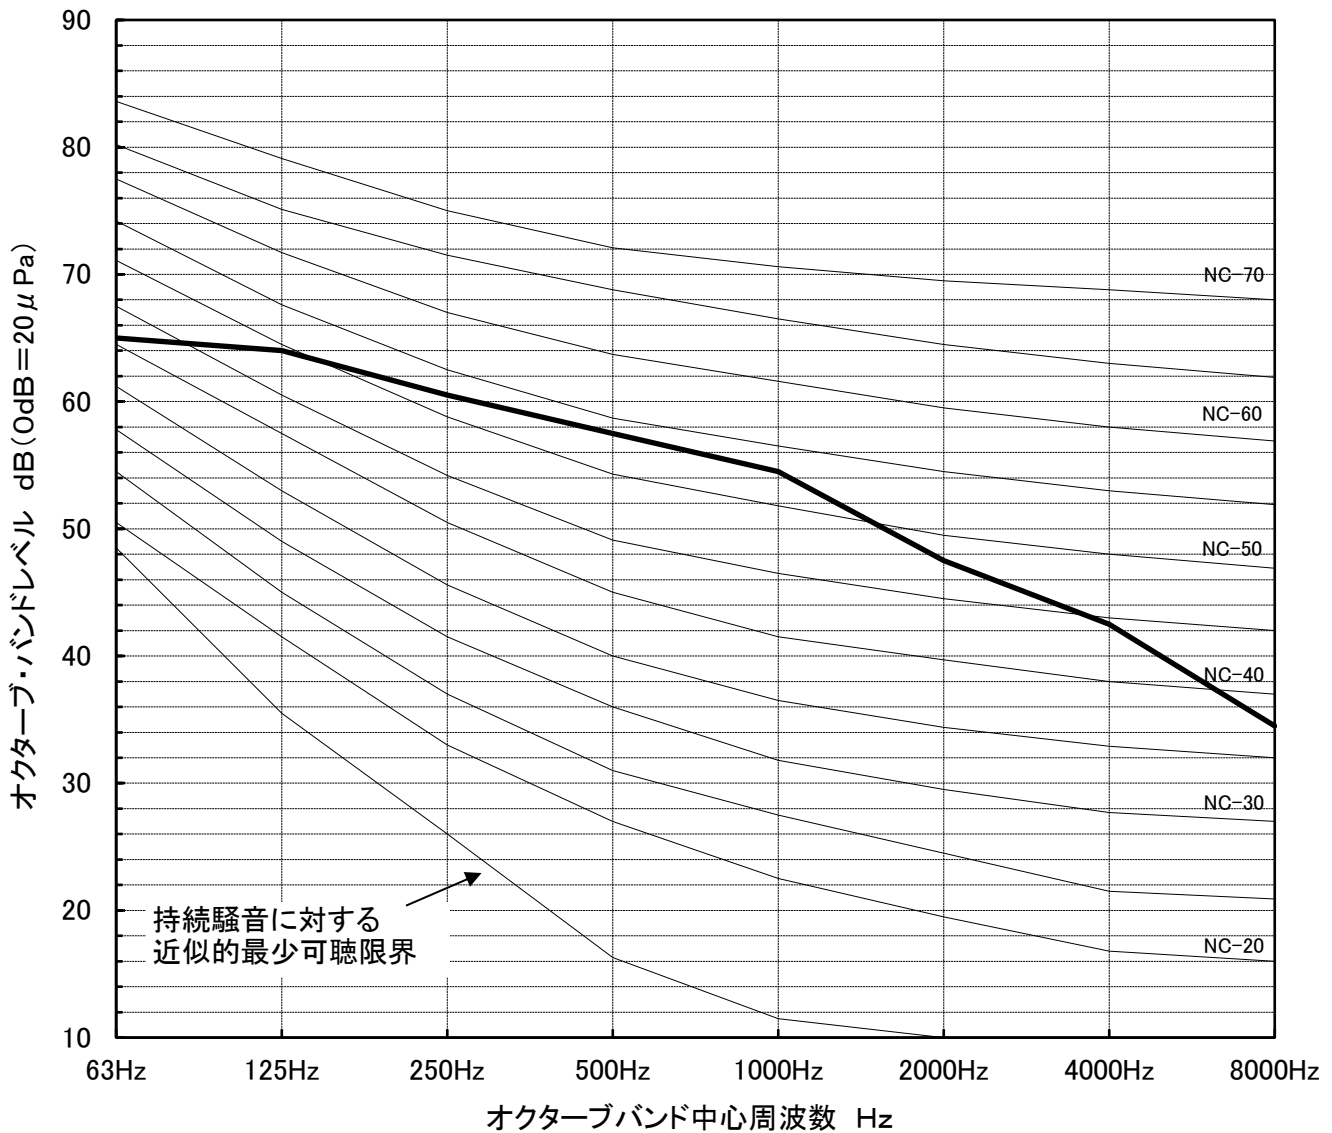

騒音分析成績表

PFAV-XP280(V)DMJ (別売プレミアム取付時)
別売形名:PAC-CD03PL

測定場所:無響音室
計器:B&K

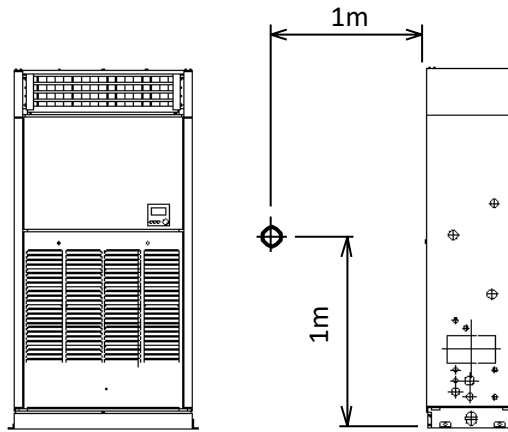

| 63Hz | 125Hz | 250Hz | 500Hz | 1000Hz | 2000Hz | 4000Hz | 8000Hz | A特性 |
|------|-------|-------|-------|--------|--------|--------|--------|---------|
| 68.0 | 67.0 | 67.5 | 64.5 | 65.0 | 60.0 | 57.5 | 52.0 | 69 (dB) |

