



騒音分析成績表

PFAV-XP450(V)DMJ

測定場所: 無響音室
計器: B&K

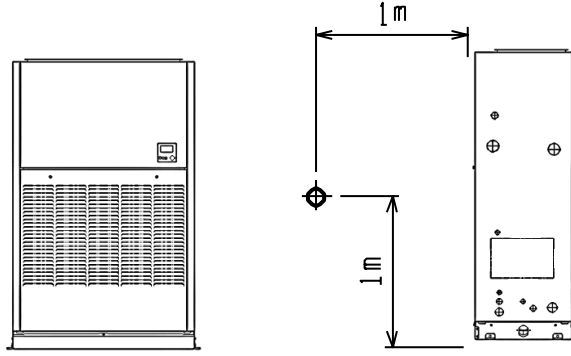


63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
63.0	60.0	59.5	56.5	53.5	49.5	46.5	38.0	59 (dB)

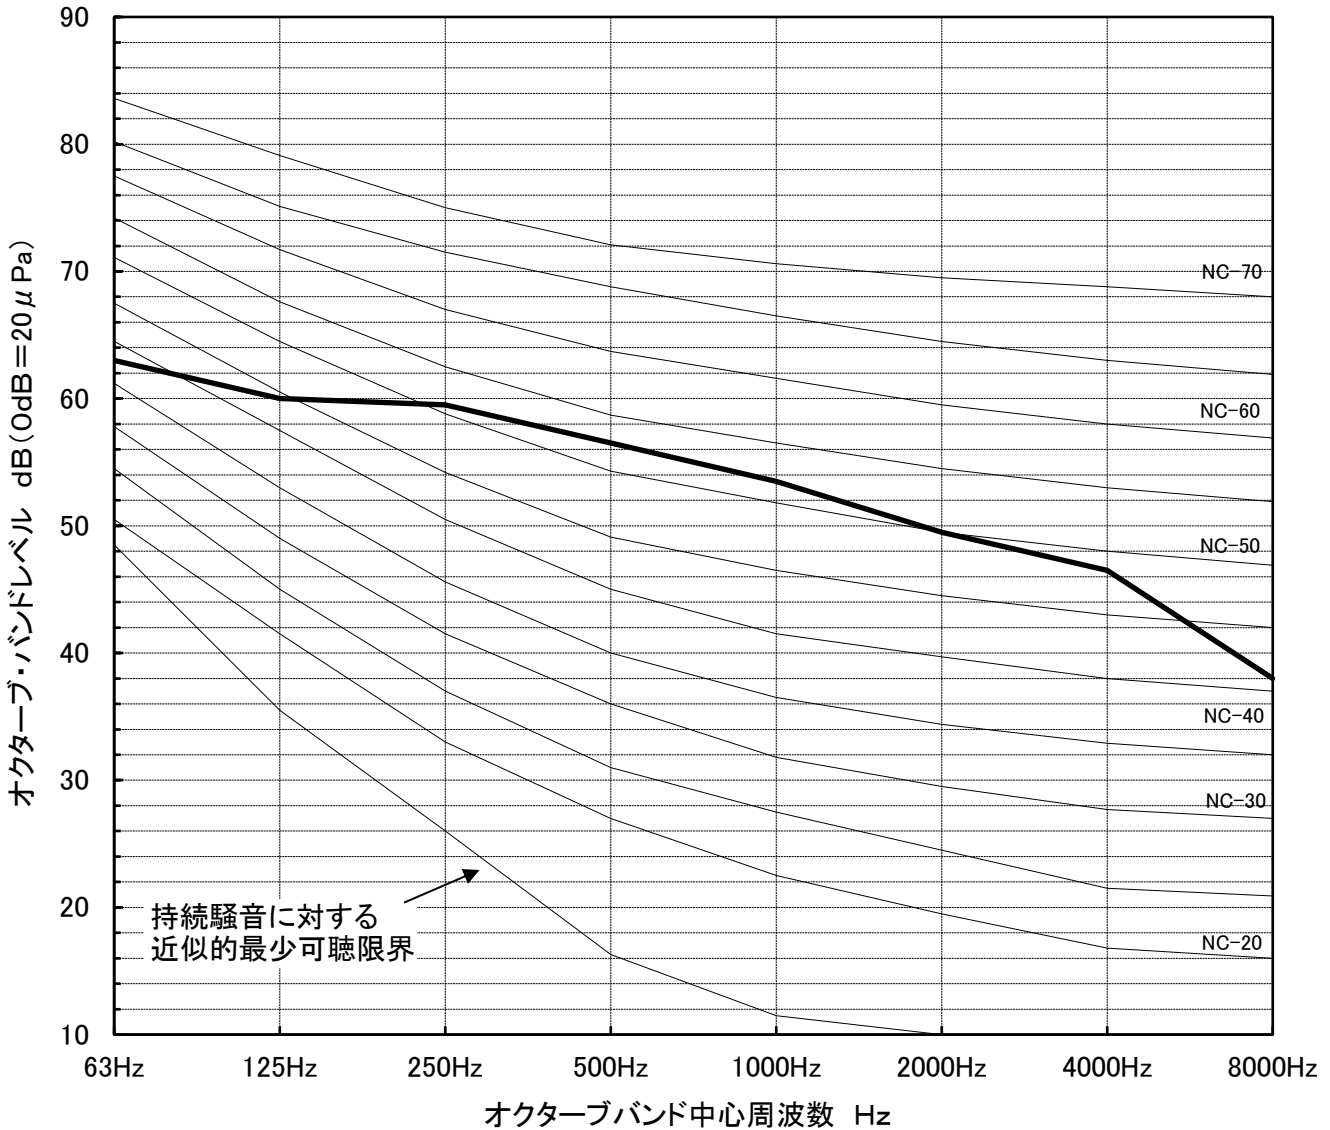

騒音分析成績表

PFAV-XP450(V)DMJ (別売プレナム取付時)
別売形名:PAC-CD05PL

測定場所:無響音室
計器:B&K

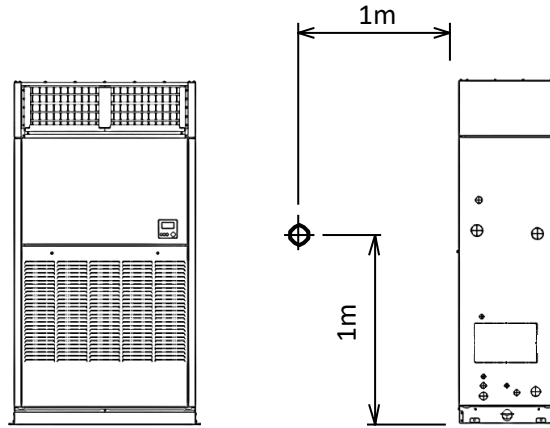

63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
68.0	64.0	65.0	63.0	60.5	58.5	54.5	46.0	66 (dB)

