



騒音分析成績表

PFAV-XP560(V)DMJ

測定場所: 無響音室
計器: B&K

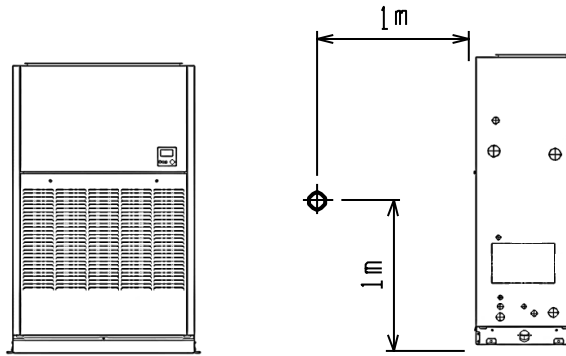


63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
65.5	63.0	61.5	59.0	57.5	53.0	49.5	42.0	62 (dB)

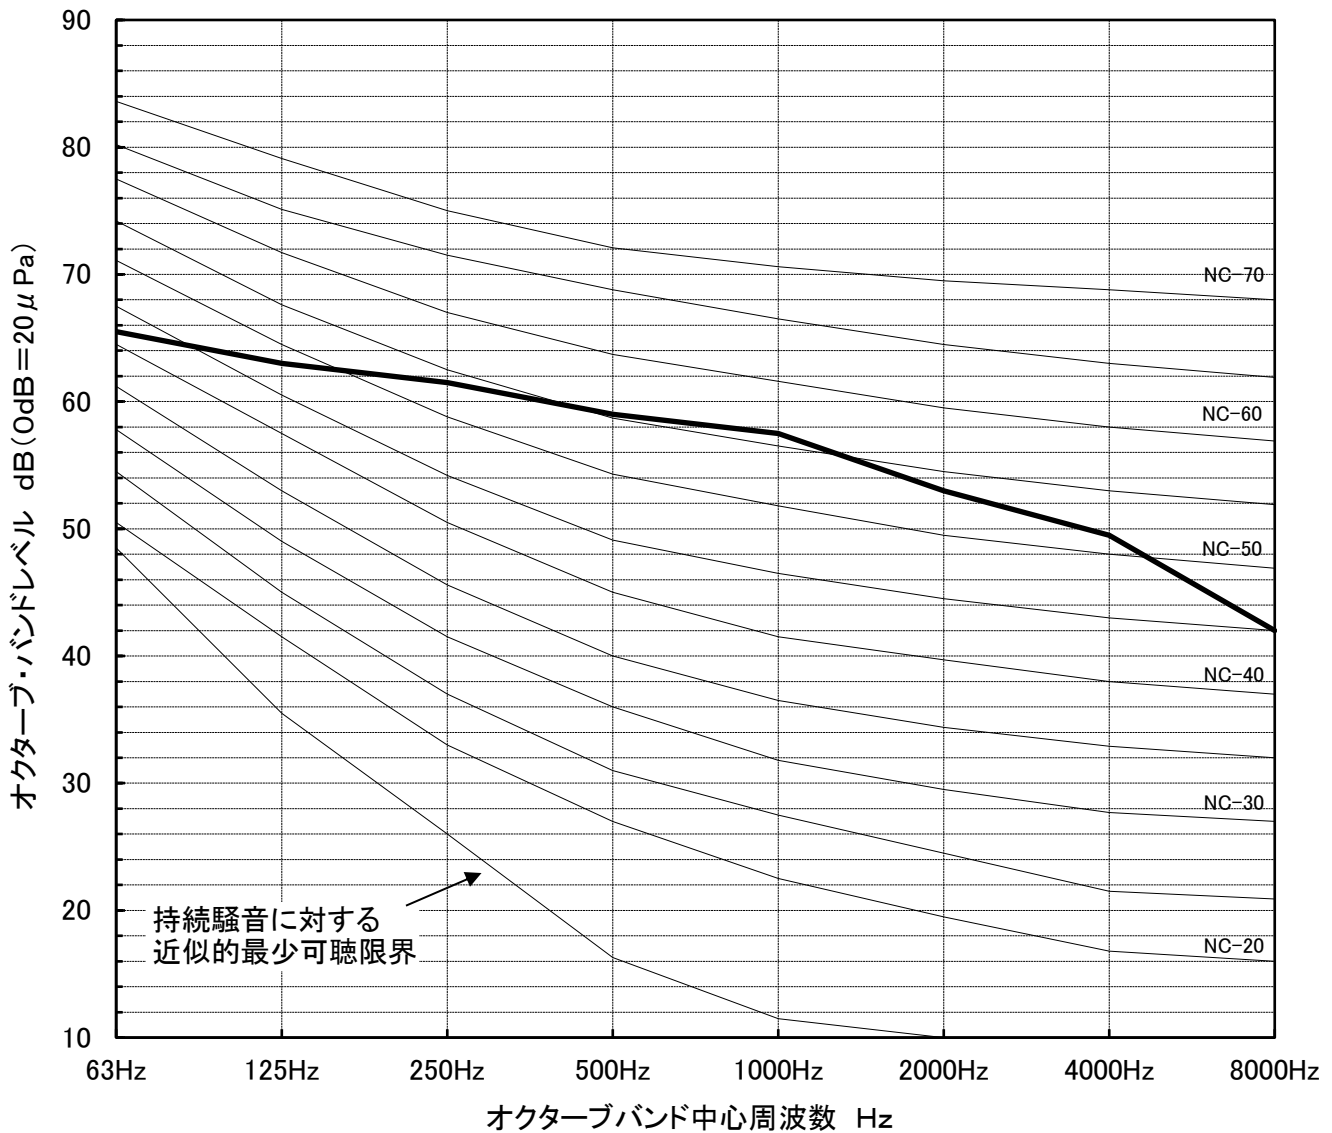

騒音分析成績表

PFAV-XP560(V)DMJ (別売プレミアム取付時)
別売形名:PAC-CD05PL

測定場所:無響音室
計器:B&K

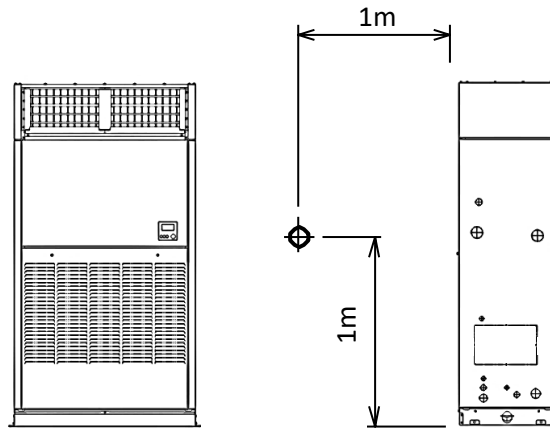

63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
71.5	68.0	68.5	67.0	64.5	63.0	58.5	50.5	70 (dB)

