



騒音分析成績表

PFAV-XP450DMJ (別売プレナム取付時)
別売形名:PAC-CD05PL

測定場所:無響音室
計器:B&K

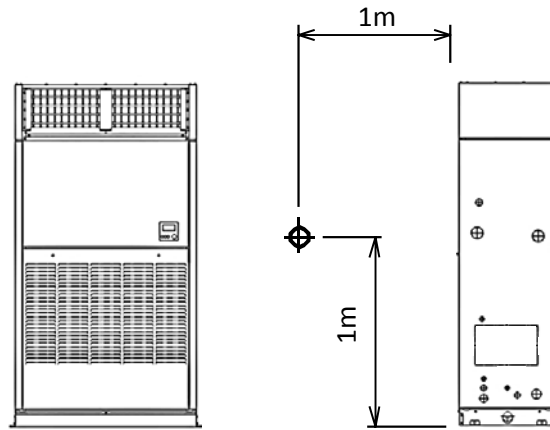


63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
68.0	64.0	65.0	63.0	60.5	58.5	54.5	46.0	66 (dB)

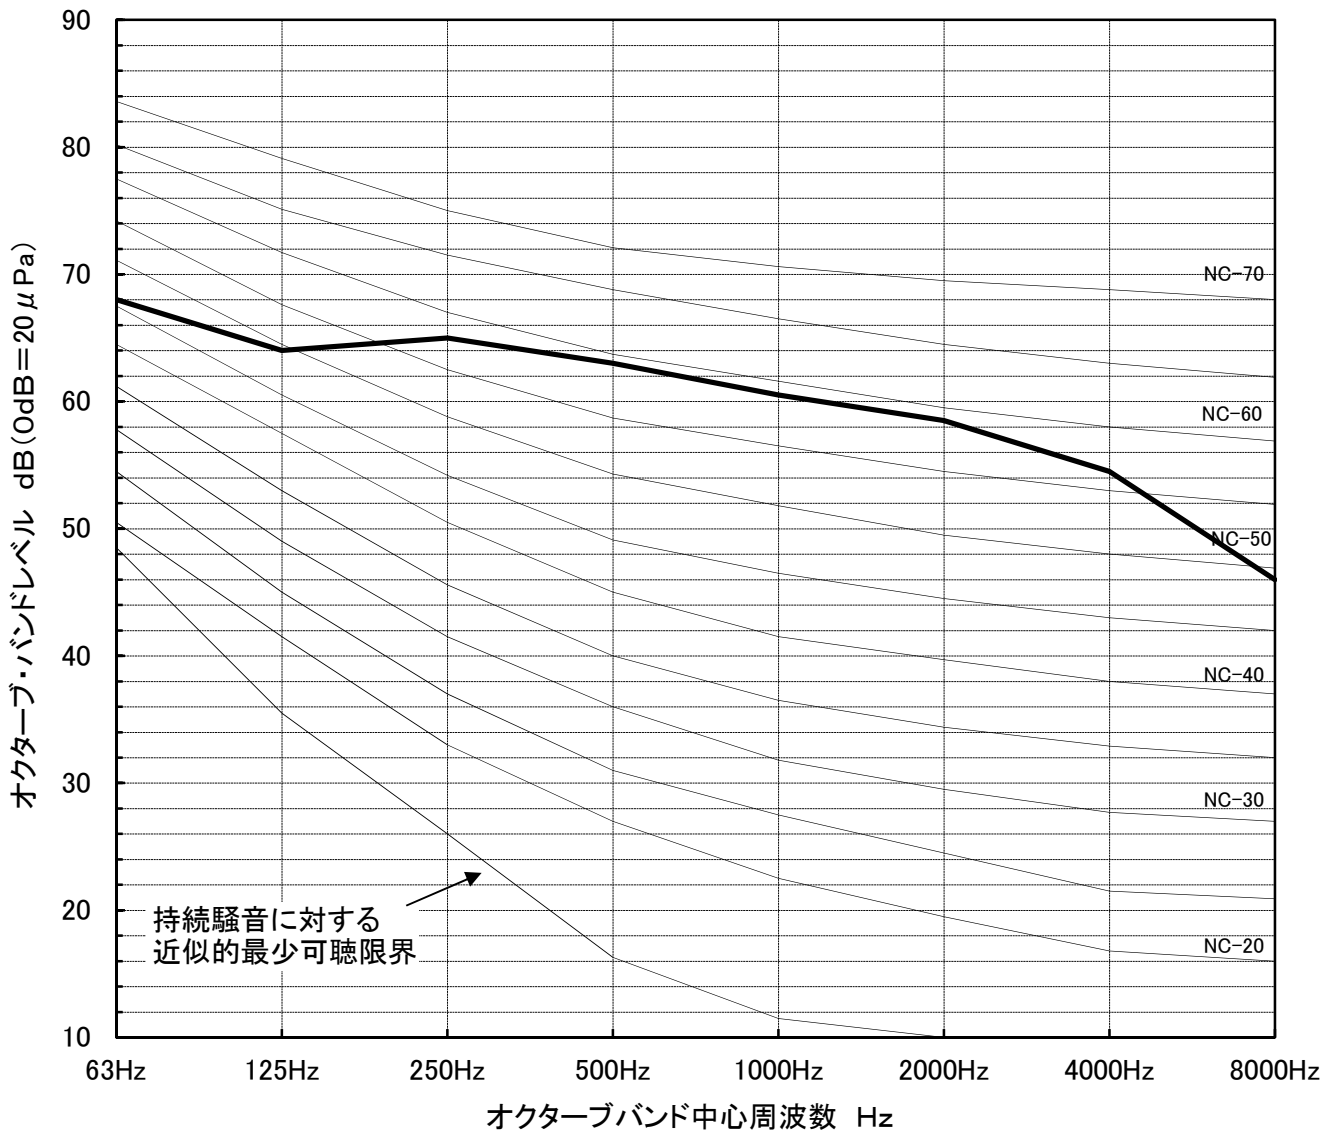

騒音分析成績表

PFAV-XP560DMJ (別売プレナム取付時)
別売形名:PAC-CD05PL

測定場所:無響音室
計器:B&K

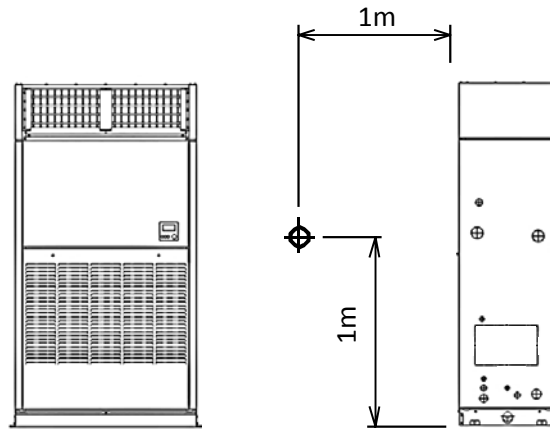

63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
71.5	68.0	68.5	67.0	64.5	63.0	58.5	50.5	70 (dB)

