


PUHY-EP500～1400SDMG6(-BS,-BSG) 振動レベル値

1. 測定条件

- ①測定周波数帯 : 1Hz～80Hz
- ②測定位置 : ユニット脚部より20cmの距離の路面
- ③据付状態 : コンクリート床面直置
- ④電源 : 三相200V 50Hz/60Hz
- ⑤運転条件 : JIS条件(冷房、暖房)
- ⑥測定機器 : 公害用振動レベル計 VM-1220C
(JIS適合品)

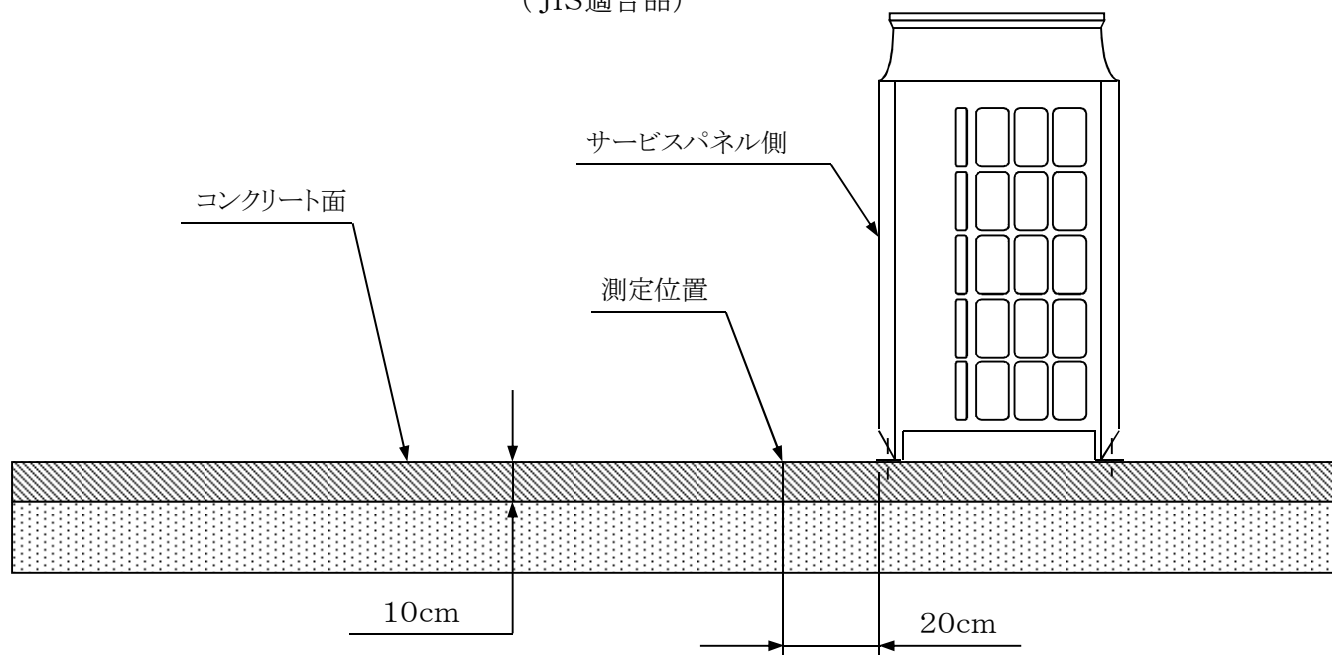

2. 振動レベル値

形名	振動レベル値 <dB>
PUHY-EP500SDMG6(-BS,-BSG)	48.5
PUHY-EP560SDMG6(-BS,-BSG)	49
PUHY-EP630SDMG6(-BS,-BSG)	49.5
PUHY-EP670SDMG6(-BS,-BSG)	50
PUHY-EP730SDMG6(-BS,-BSG)	50
PUHY-EP775SDMG6(-BS,-BSG)	50
PUHY-EP850SDMG6(-BS,-BSG)	50
PUHY-EP900SDMG6(-BS,-BSG)	50
PUHY-EP950SDMG6(-BS,-BSG)	50
PUHY-EP1000SDMG6(-BS,-BSG)	50
PUHY-EP1060SDMG6(-BS,-BSG)	52
PUHY-EP1120SDMG6(-BS,-BSG)	52
PUHY-EP1180SDMG6(-BS,-BSG)	52
PUHY-EP1220SDMG6(-BS,-BSG)	52
PUHY-EP1280SDMG6(-BS,-BSG)	52
PUHY-EP1360SDMG6(-BS,-BSG)	52
PUHY-EP1400SDMG6(-BS,-BSG)	52

<注> 上記値は暗振動補正を行ったものである。