



騒音分析成績表

PURY-P335(S)DMG9(-BS,-BSG)

測定場所: 無響音室
計器: B&K

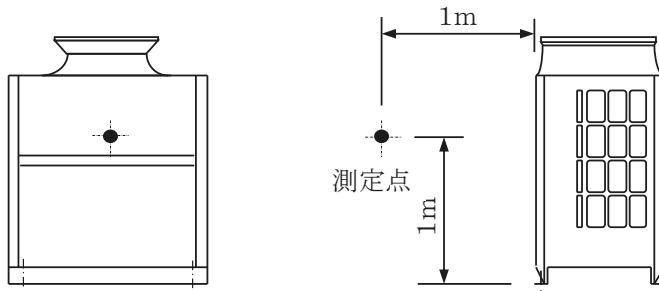

		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性	
標準	50/60Hz	72.5	68	63.5	60.5	54.5	47.5	41.5	37	61.5	(dB)
低騒音	50/60Hz	61	57.5	50	47.5	43.5	40	34	36	50	(dB)

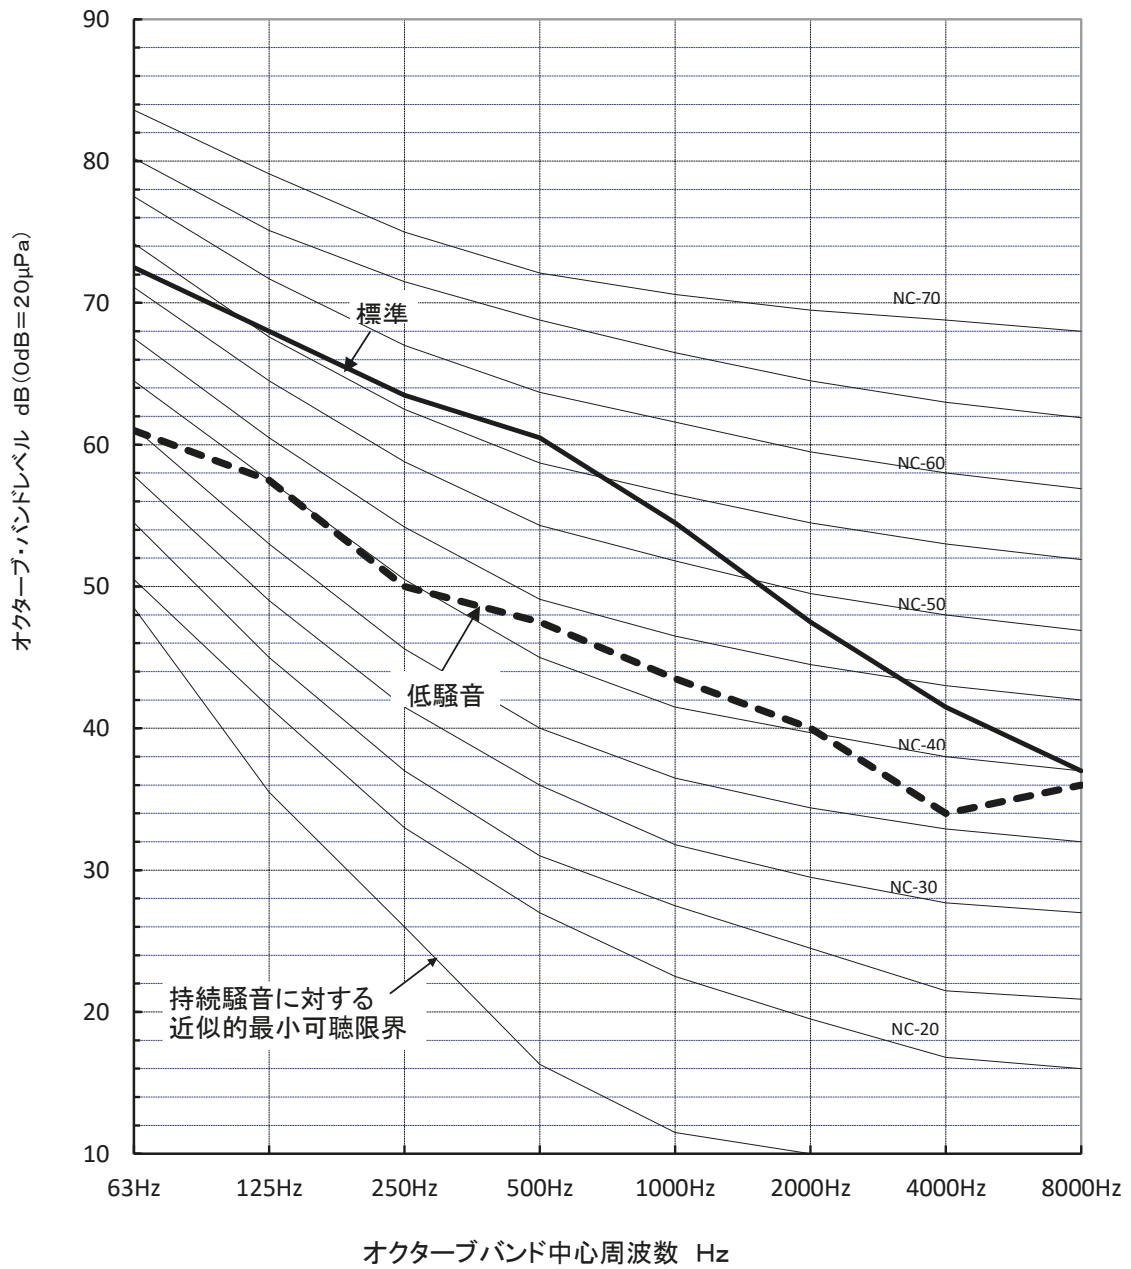

騒音分析成績表 (PWL)

PURY-P335DMG9(-BS,-BSG)

測定場所: 無響音室
計 器: B&K

		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性	
標準	50/60Hz		88.5	86.5	83.5	79.0	74.0	70.5	62.5	85.0	(dB)
低騒音	50/60Hz		77.0	69.5	67.0	63.5	59.5	53.5	55.5	69.5	(dB)

騒音値はJRA4065:2013に基づいた値です

