
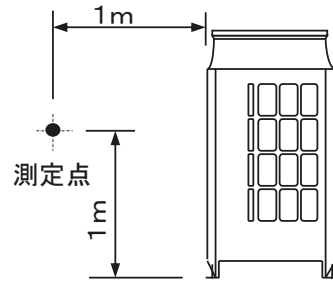



騒音分析成績表

PURY-EP224(S)DMG9(-BS,-BSG)

測定場所: 無響音室
計器: B&K



		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性	
標準	50/60Hz	73.5	64.5	60.5	56.5	50	44	38	33	58	(dB)
低騒音	50/60Hz	55.5	52.5	48.5	43	33.5	32	33	28	45	(dB)

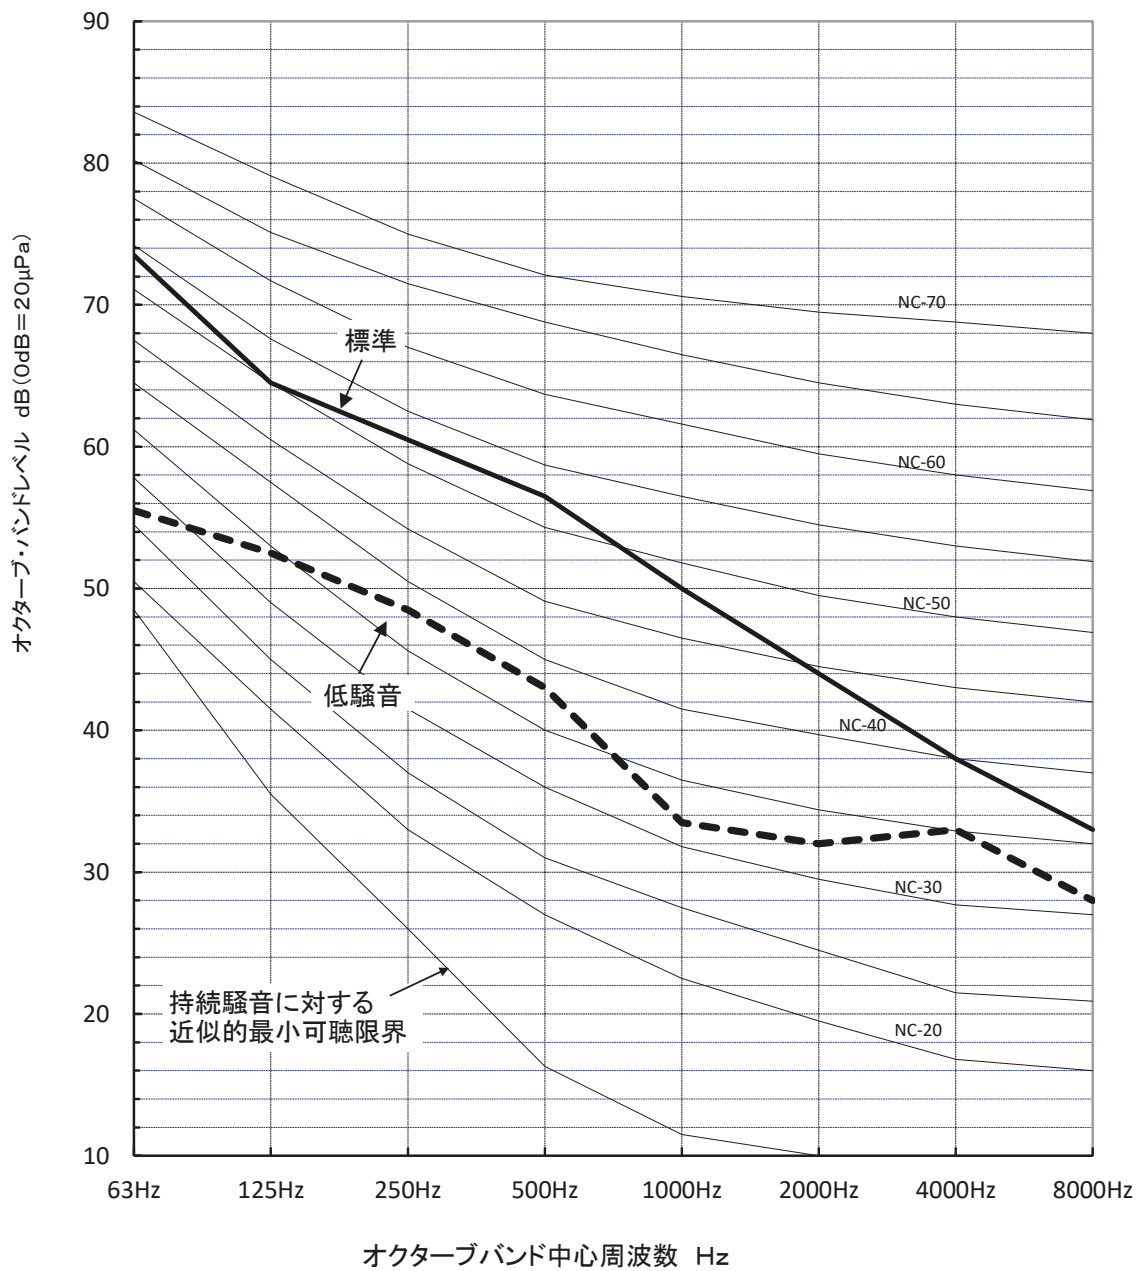

騒音分析成績表(PWL) PURY-EP224DMG9(-BS,-BSG)

測定場所:無響音室

		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性	
標準	50/60Hz		86.0	82.0	79.5	75.5	72.0	68.0	61.0	81.5	(dB)
低騒音	50/60Hz		75.5	71.5	66.0	56.5	55.0	56.0	51.0	68.0	(dB)

騒音値はJRA4065:2013に基づいた値です

