



騒音分析成績表

PURY-EP280(S)DMG9(-BS,-BSG)

測定場所: 無響音室
計器: B&K

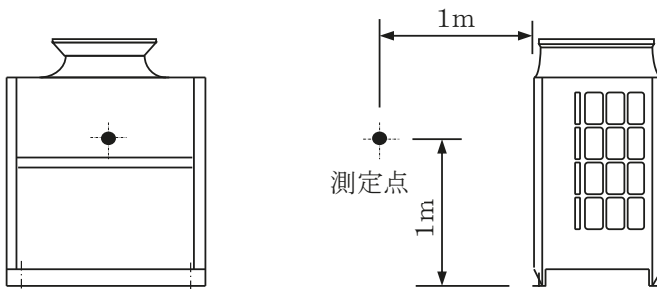

		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性	
標準	50/60Hz	70	65.5	61.5	57.5	52	45.5	39	36.5	59	(dB)
低騒音	50/60Hz	61	57.5	48.5	47	43.5	41.5	34	36	50	(dB)

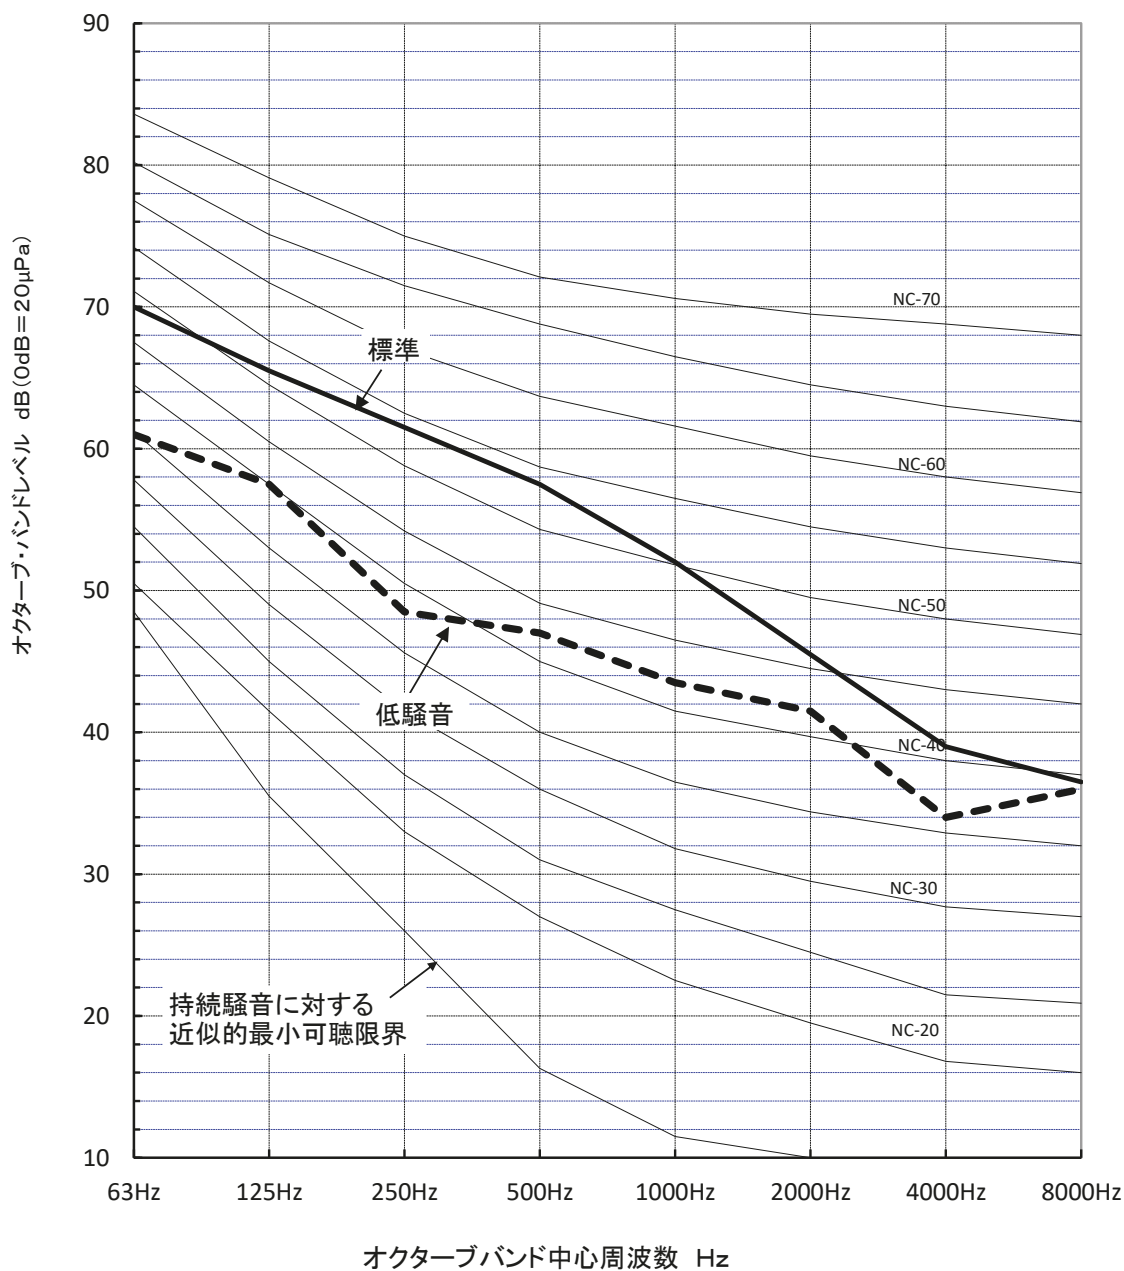

騒音分析成績表(PWL) PURY-EP280DMG9(-BS,-BSG)

測定場所:無響音室

		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
標準	50/60Hz		85.5	83.5	81.0	76.5	72.5	68.5	60.5	82.5 (dB)
低騒音	50/60Hz		75.5	66.5	65.0	62.0	60.0	52.0	54.0	68.0 (dB)

騒音値はJRA4065:2013に基づいた値です

