



騒音分析成績表

PURY-EP335(S)DMG9(-BS,-BSG)

測定場所: 無響音室
計器: B&K

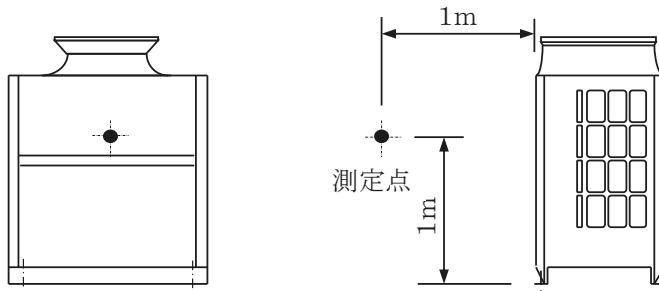

		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性	
標準	50/60Hz	70	66	61	57.5	52	46	40.5	37	59	(dB)
低騒音	50/60Hz	61	57.5	49.5	47.5	43.5	40.5	34.5	37	50	(dB)

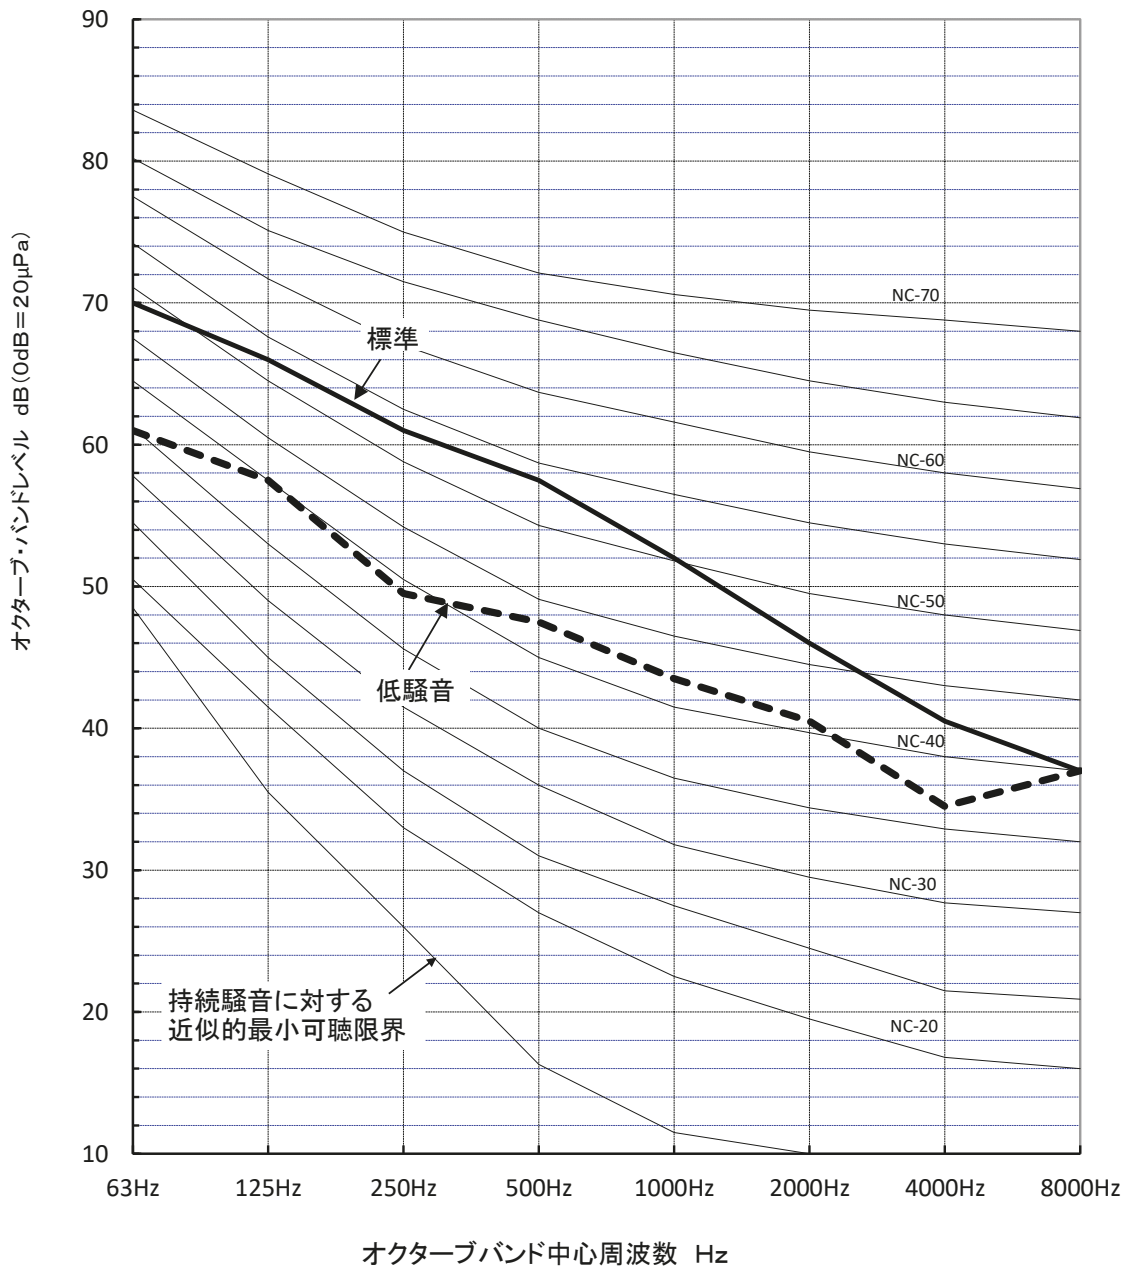

騒音分析成績表(PWL) PURY-EP335DMG9(-BS,-BSG)

測定場所:無響音室

		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
標準	50/60Hz		85.5	84.0	81.0	76.5	72.0	68.5	60.5	82.5 (dB)
低騒音	50/60Hz		75.5	67.5	65.5	62.0	58.5	52.5	55.0	68.0 (dB)

騒音値はJRA4065:2013に基づいた値です

