



騒音分析成績表

PURY-EP400DMG9(-BS,-BSG)

測定場所: 無響音室
計器: B&K

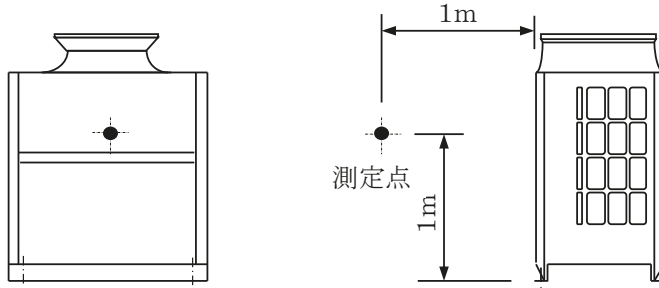

		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性	
標準	50/60Hz	73	68	64	61	55	48	42	37	62	(dB)
低騒音	50/60Hz	61	57.5	50	48	43	40	34.5	35.5	50	(dB)

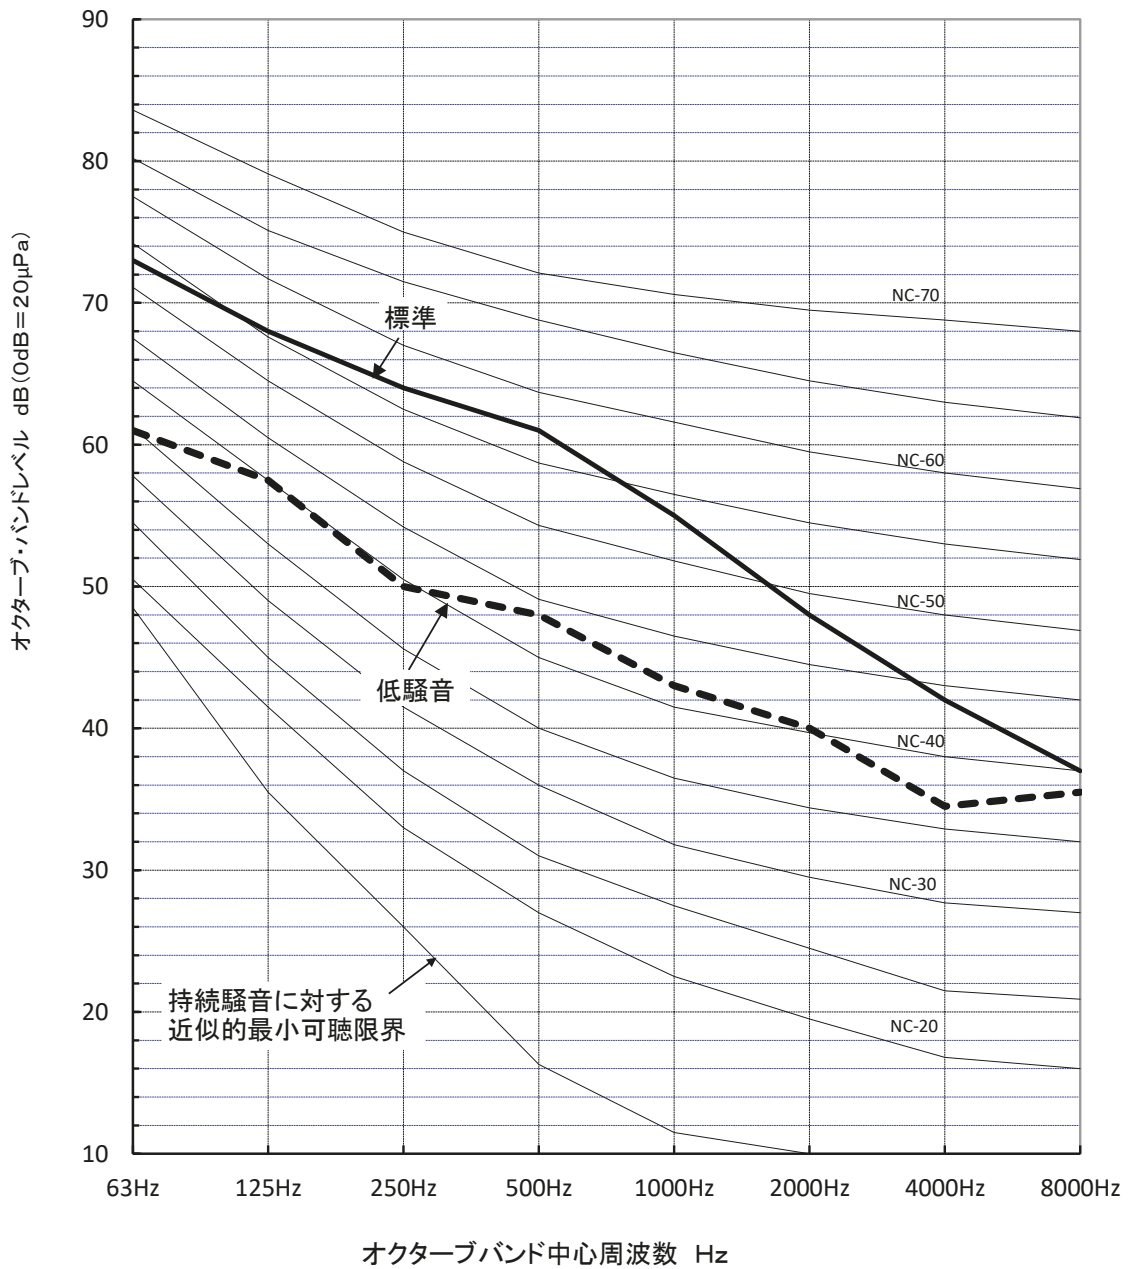

騒音分析成績表(PWL) PURY-EP400DMG9(-BS,-BSG)

測定場所:無響音室

		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
標準	50/60Hz		90.0	83.0	84.5	80.0	75.5	71.5	63.5	85.5 (dB)
低騒音	50/60Hz		78.0	70.5	68.5	64.0	60.5	55.0	56.0	70.5 (dB)

騒音値はJRA4065:2013に基づいた値です

