



騒音分析成績表

PURY-EP400(K)DMG9(-E)(-BS,-BSG)

測定場所: 無響音室
計器: B&K

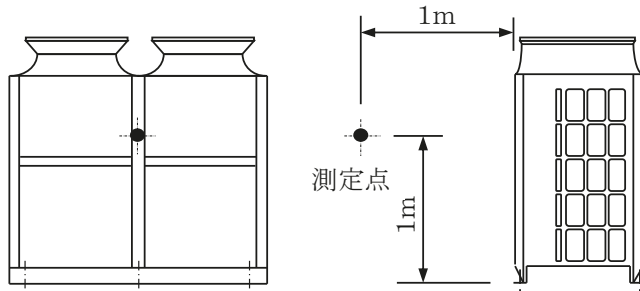

		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性	
標準	50/60Hz	70	66.5	62	58.5	53	48	43	38.5	60	(dB)
低騒音	50/60Hz	63.5	60	51	49	45.5	43	37	38	52	(dB)

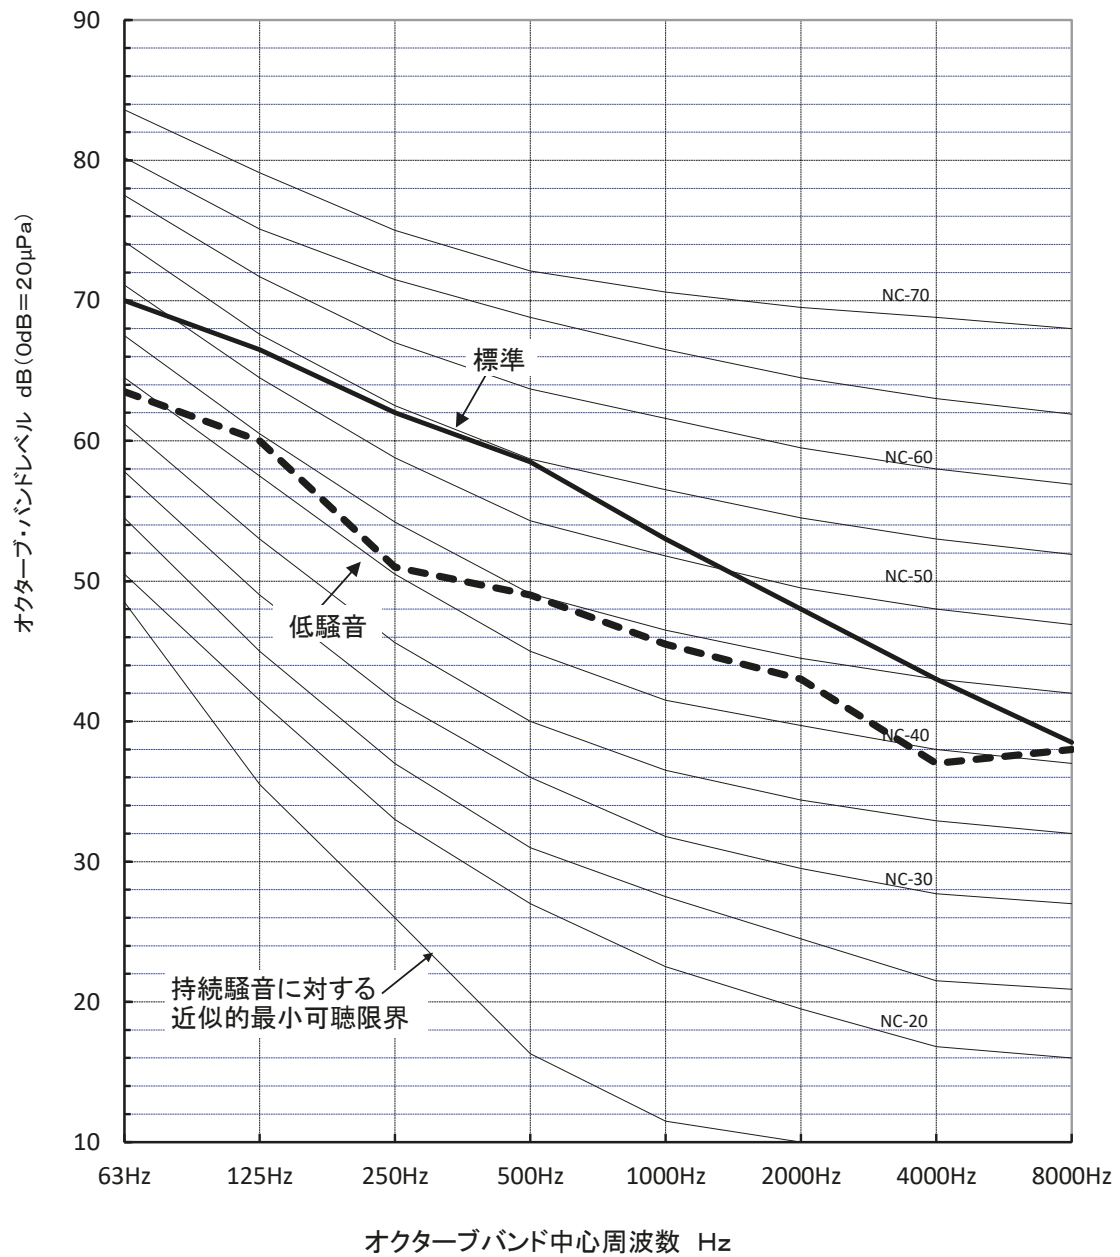

騒音分析成績表

PURY-EP400DMG9-E(-BS,-BSG)

測定場所: 無響音室
計 器: B&K

		63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性	
標準	50/60Hz		86.5	83.5	81.0	77.0	73.5	70.0	63.5	83.0	(dB)
低騒音	50/60Hz		77.5	68.5	66.5	63.5	60.5	54.5	55.5	69.5	(dB)

騒音値はJRA4065:2013に基づいた値です

