



騒音分析成績表

CMB-(R) P104~(R) P1016GG3
 CMB-(R) P108~(R) P1016GAG3
 CMB-(R) P104・(R) P108GBG3

測定場所: 無響音室
 計器: B&K




63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性 (dB)
29	36	36	38	35	31.5	29	25	40

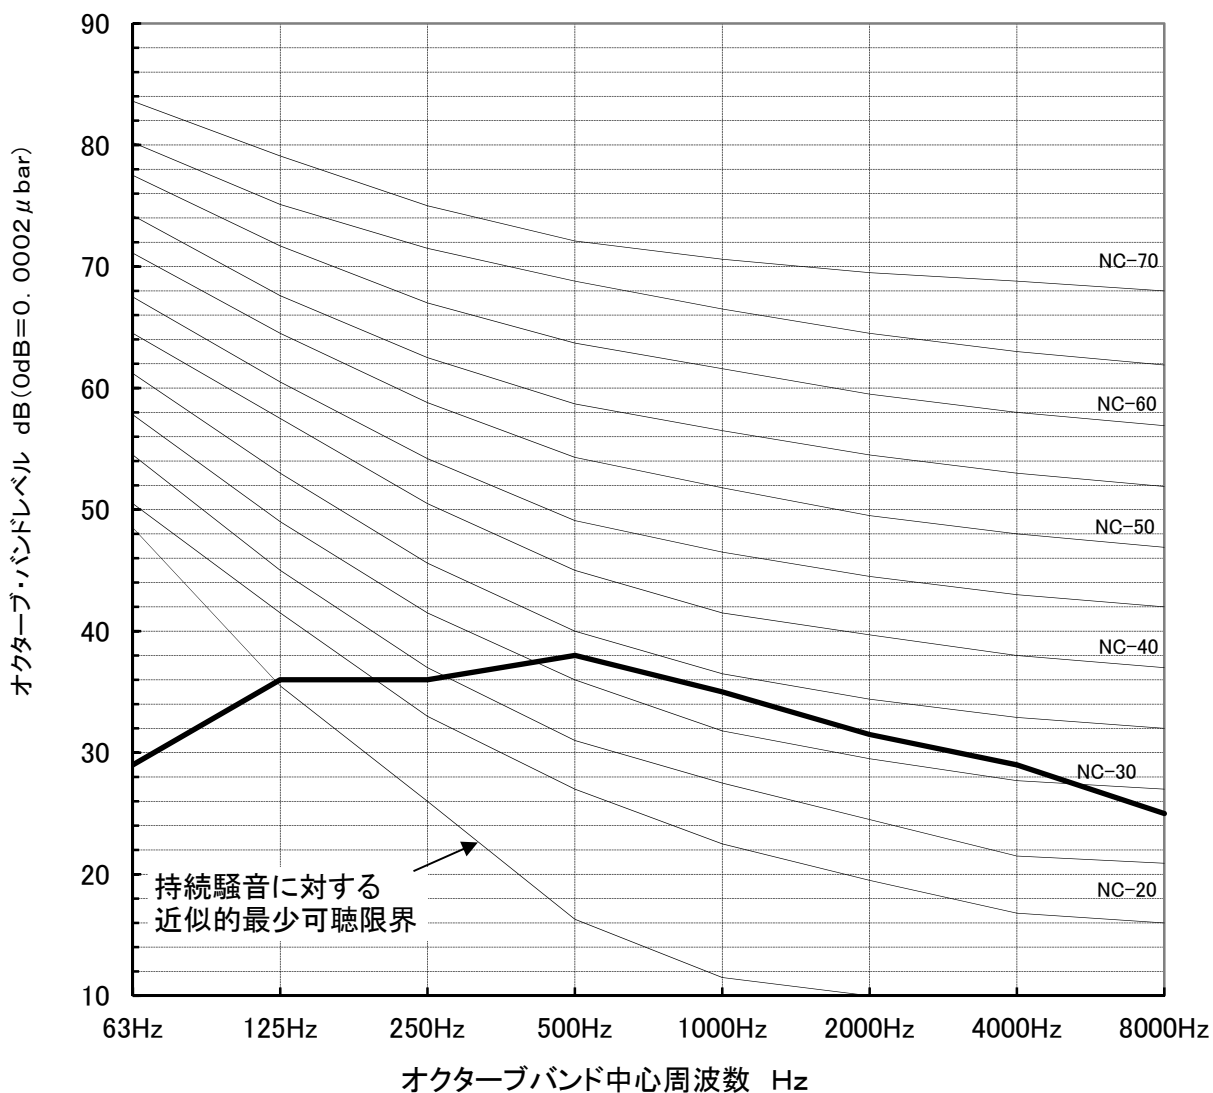

騒音分析成績表

CMB-(R) P104~(R) P1016GG3
 CMB-(R) P108~(R) P1016GAG3
 CMB-(R) P104・(R) P108GBG3

測定場所: 無響音室
 計器: B&K



電磁弁切換時

63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性 (dB)
29.5	36.5	35.5	37	34	31	47	27.5	49

