



騒音分析成績表

PFAV-P224DMJ

測定場所: 無響音室
計 器: B&K

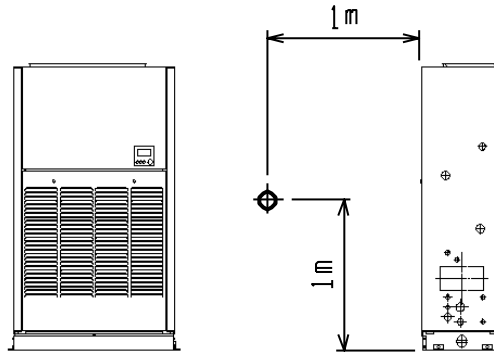


63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
61.0	60.5	53.5	50.5	43.0	37.5	32.0	25.0	52 (dB)

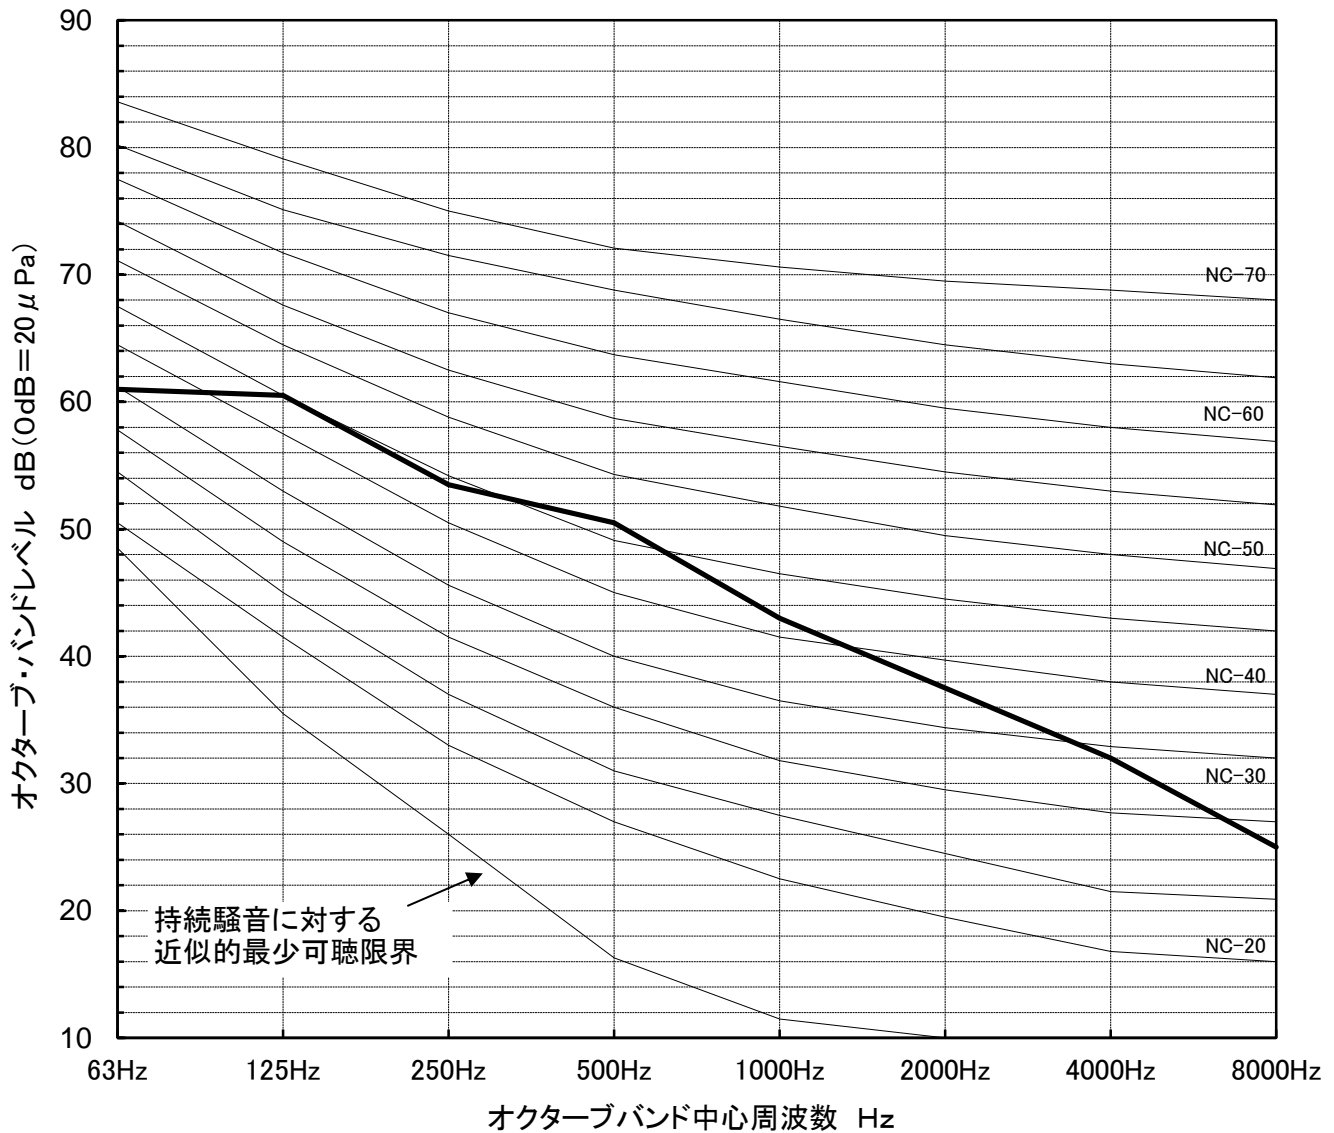

騒音分析成績表

PFAV-P224DMJ (別売プレナム取付時)

測定場所: 無響音室
計 器: B&K

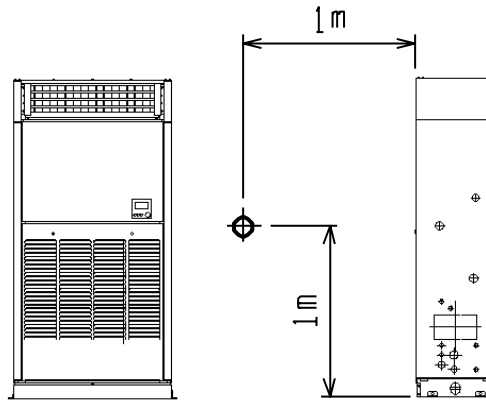

63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
63.0	64.0	60.5	57.5	53.5	51.5	45.5	39.0	60 (dB)

