



騒音分析成績表

PFAV-P280DMJ

測定場所: 無響音室
計 器: B&K

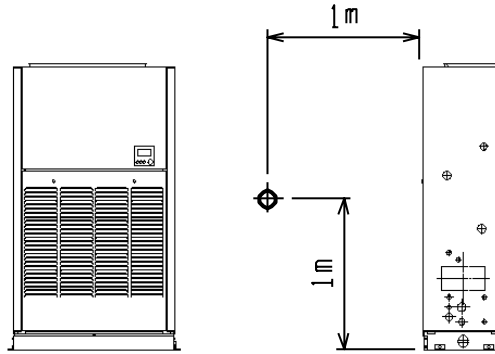


63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
65.5	66.5	61.5	58.0	52.5	45.5	40.5	36.0	59.5 (dB)

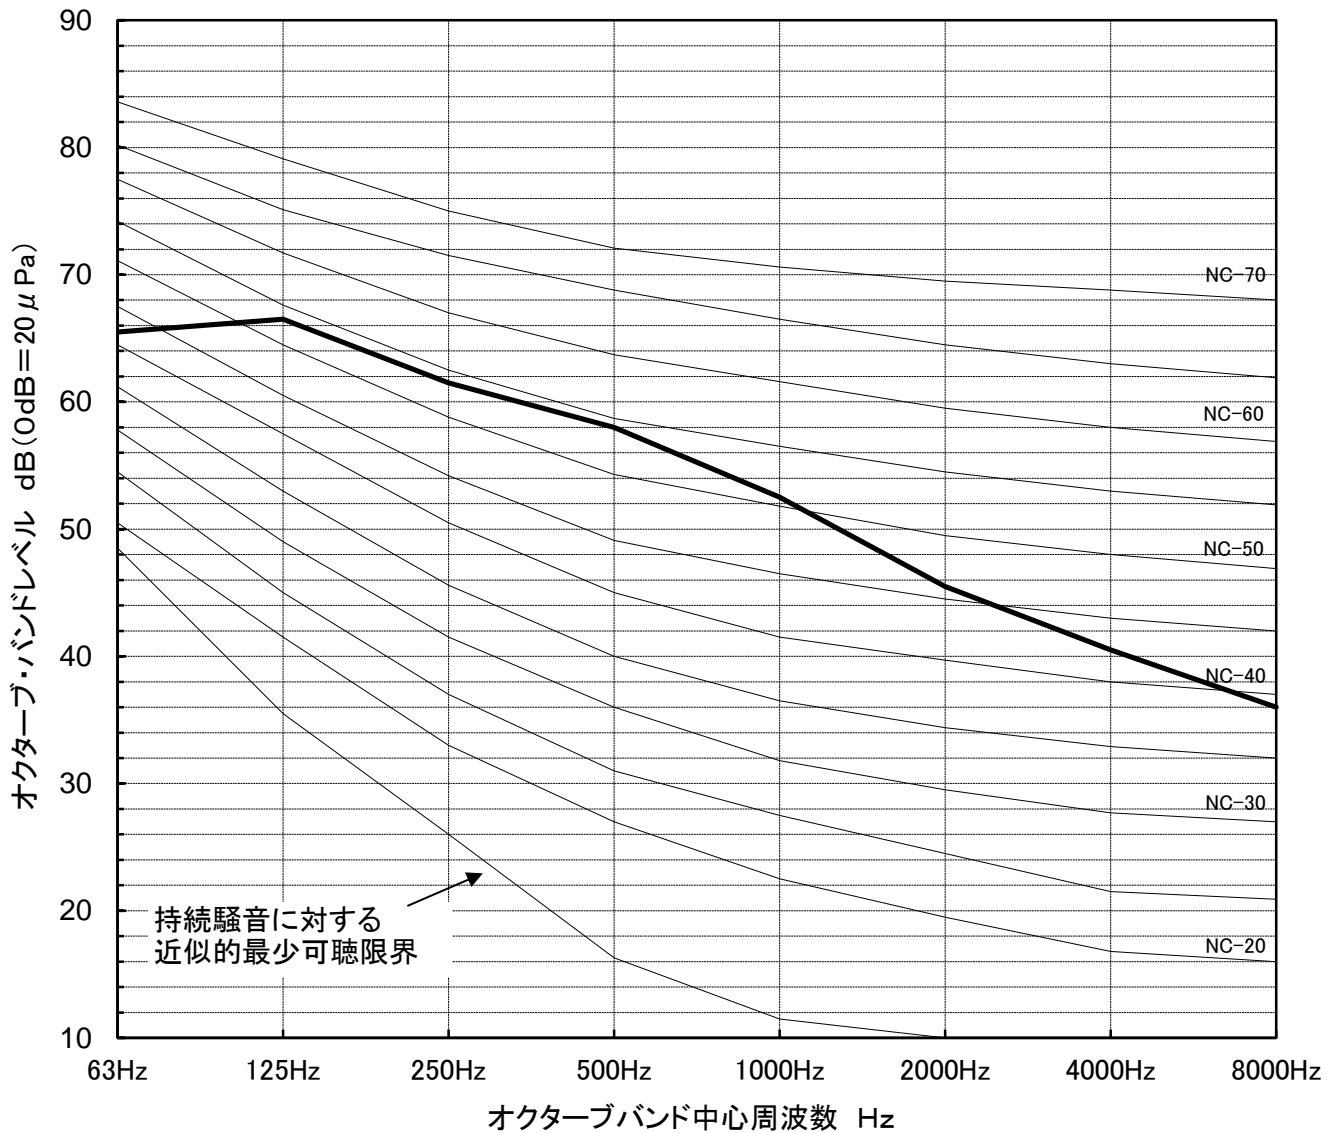

騒音分析成績表

PFAV-P280DMJ (別売プレナム取付時)

測定場所: 無響音室
計 器: B&K

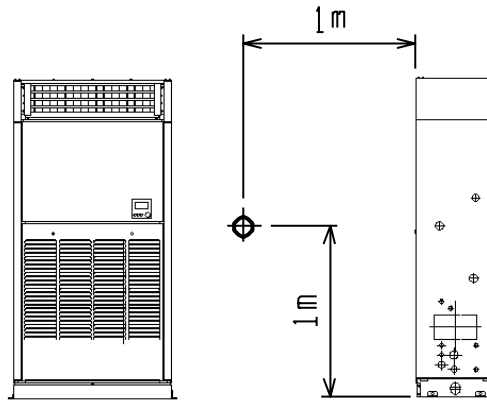

63Hz	125Hz	250Hz	500Hz	1000Hz	2000Hz	4000Hz	8000Hz	A特性
70.5	71.0	69.0	65.5	63.5	60.0	57.5	50.5	69 (dB)

