



騒音分析成績表

PFD-P960VCM-E (-2C)

測定場所: 無響音室
計器: B&K

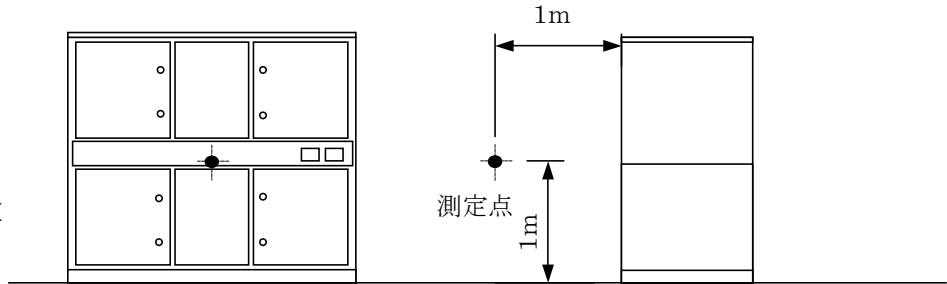


| | | 63Hz | 125Hz | 250Hz | 500Hz | 1000Hz | 2000Hz | 4000Hz | 8000Hz | A特性 |
|----|---------|------|-------|-------|-------|--------|--------|--------|--------|---------|
| 標準 | 50/60Hz | 72.5 | 64.5 | 59.0 | 54.0 | 49.5 | 44.0 | 40.5 | 41.5 | 57 (dB) |

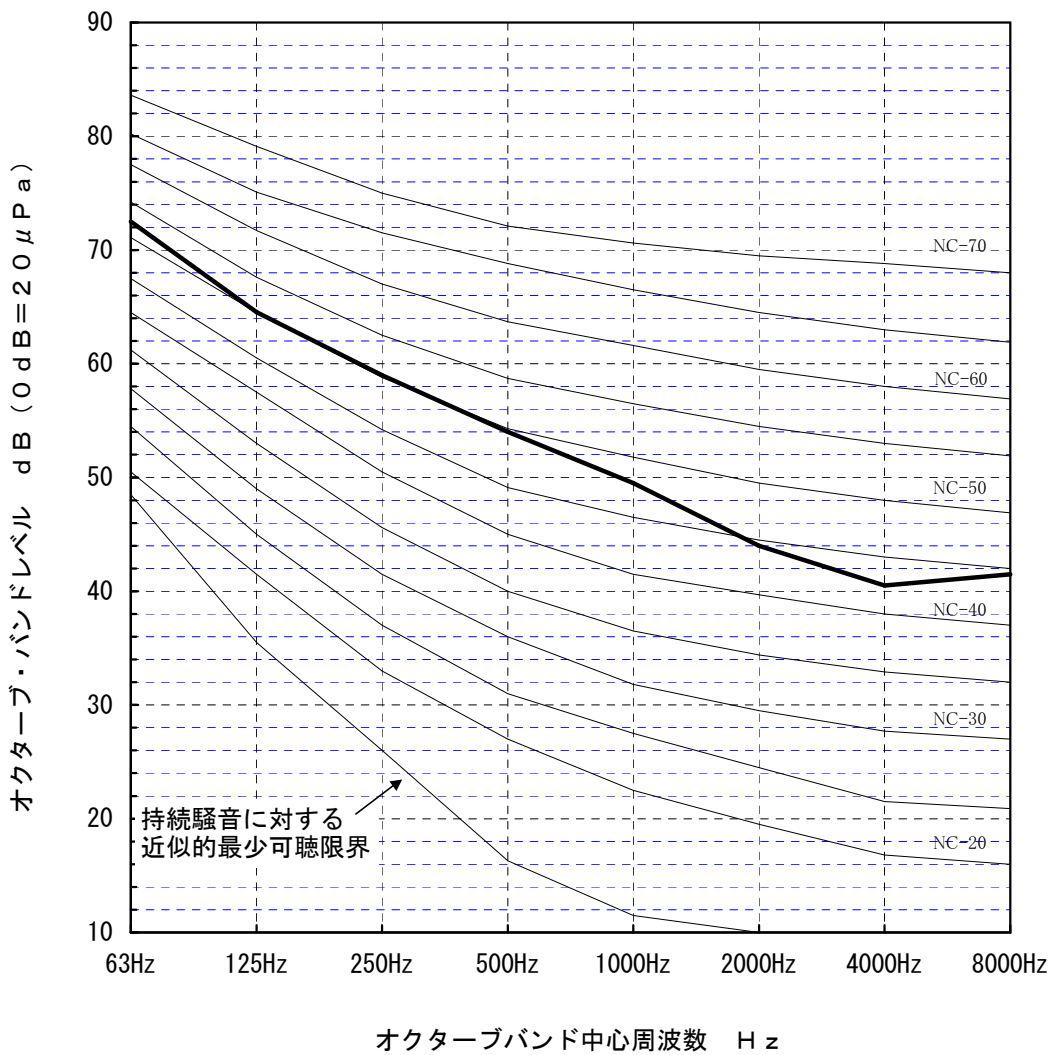

騒音分析成績表

PFD-P960VCM-E(-2C)
(中・高性能フィルター組込時)

測定場所: 無響音室
計器: B&K

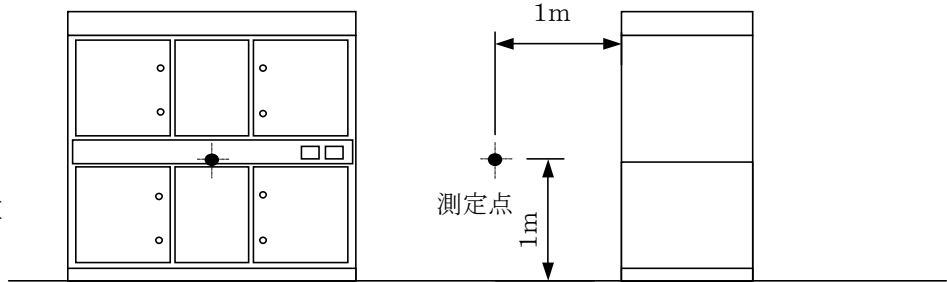

| | | 63Hz | 125Hz | 250Hz | 500Hz | 1000Hz | 2000Hz | 4000Hz | 8000Hz | A特性 |
|----|---------|------|-------|-------|-------|--------|--------|--------|--------|---------|
| 標準 | 50/60Hz | 75.5 | 69.0 | 62.5 | 57.5 | 52.5 | 49.5 | 50.5 | 41.5 | 61 (dB) |

